
SITE PLAN PREPARED FOR:

# JUNE HERMAN TEAR-DOWN ACCESSORY STRUCTURE

3588 CO RD 16 TOWN OF CANANDAIGUA COUNTY OF ONTARIO STATE OF NEW YORK

OCTOBER 6, 2021



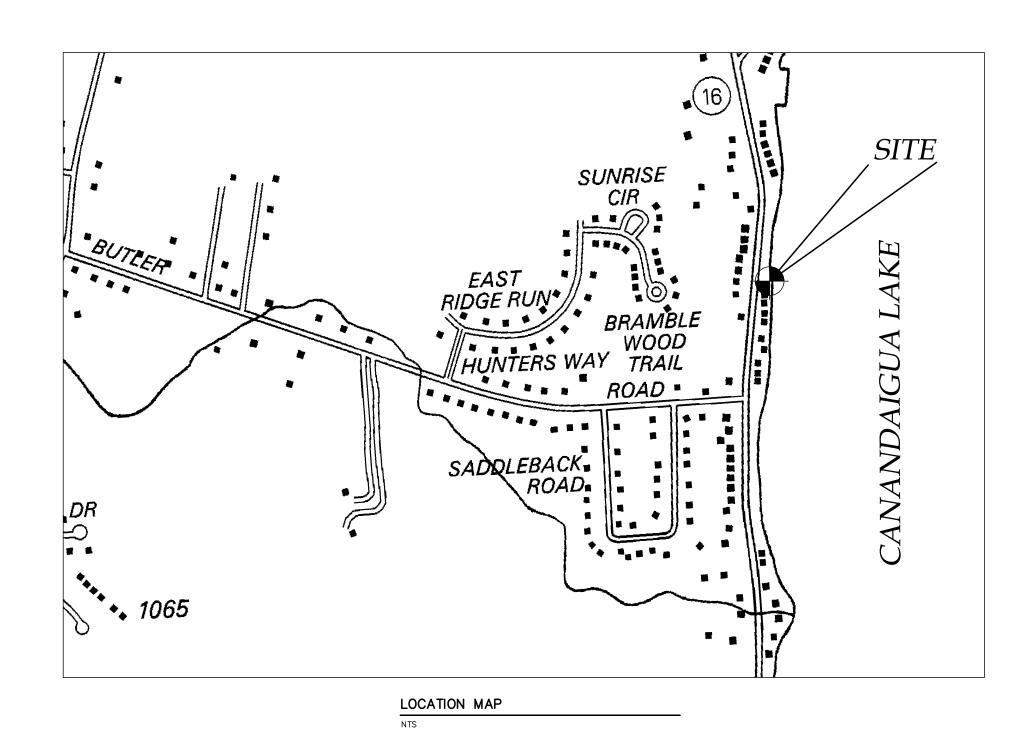



INDEX-COVER EX100- EXISTING CONDITIONS/DEMOLITION PLAN C100 - SITE PLAN C500- GENERAL DETAILS



## **Marks**Engineering

MARKS ENGINEERING, P.C.
42 BEEMAN STREET
CANANDAIGUA, NY 14424
(585)905-0360
WWW.MARKSENGINEERING.COM

PROPERTY OWNER:
JUNE G. AND ROGER M. HERMAN
3588 CO RD 16
CANANDAIGUA, NEW YORK 14424


PREPARED FOR: JUNE HERMAN

**REVISIONS:** 

1 10/22/21 TOWN OF CANANDAIGUA JI





JUNE HERMAN
3588 CO RD 16
TOWN OF CANANDAIGUA
COUNTY OF ONTARIO
NEW YORK
JOB #21-143
10/06/21

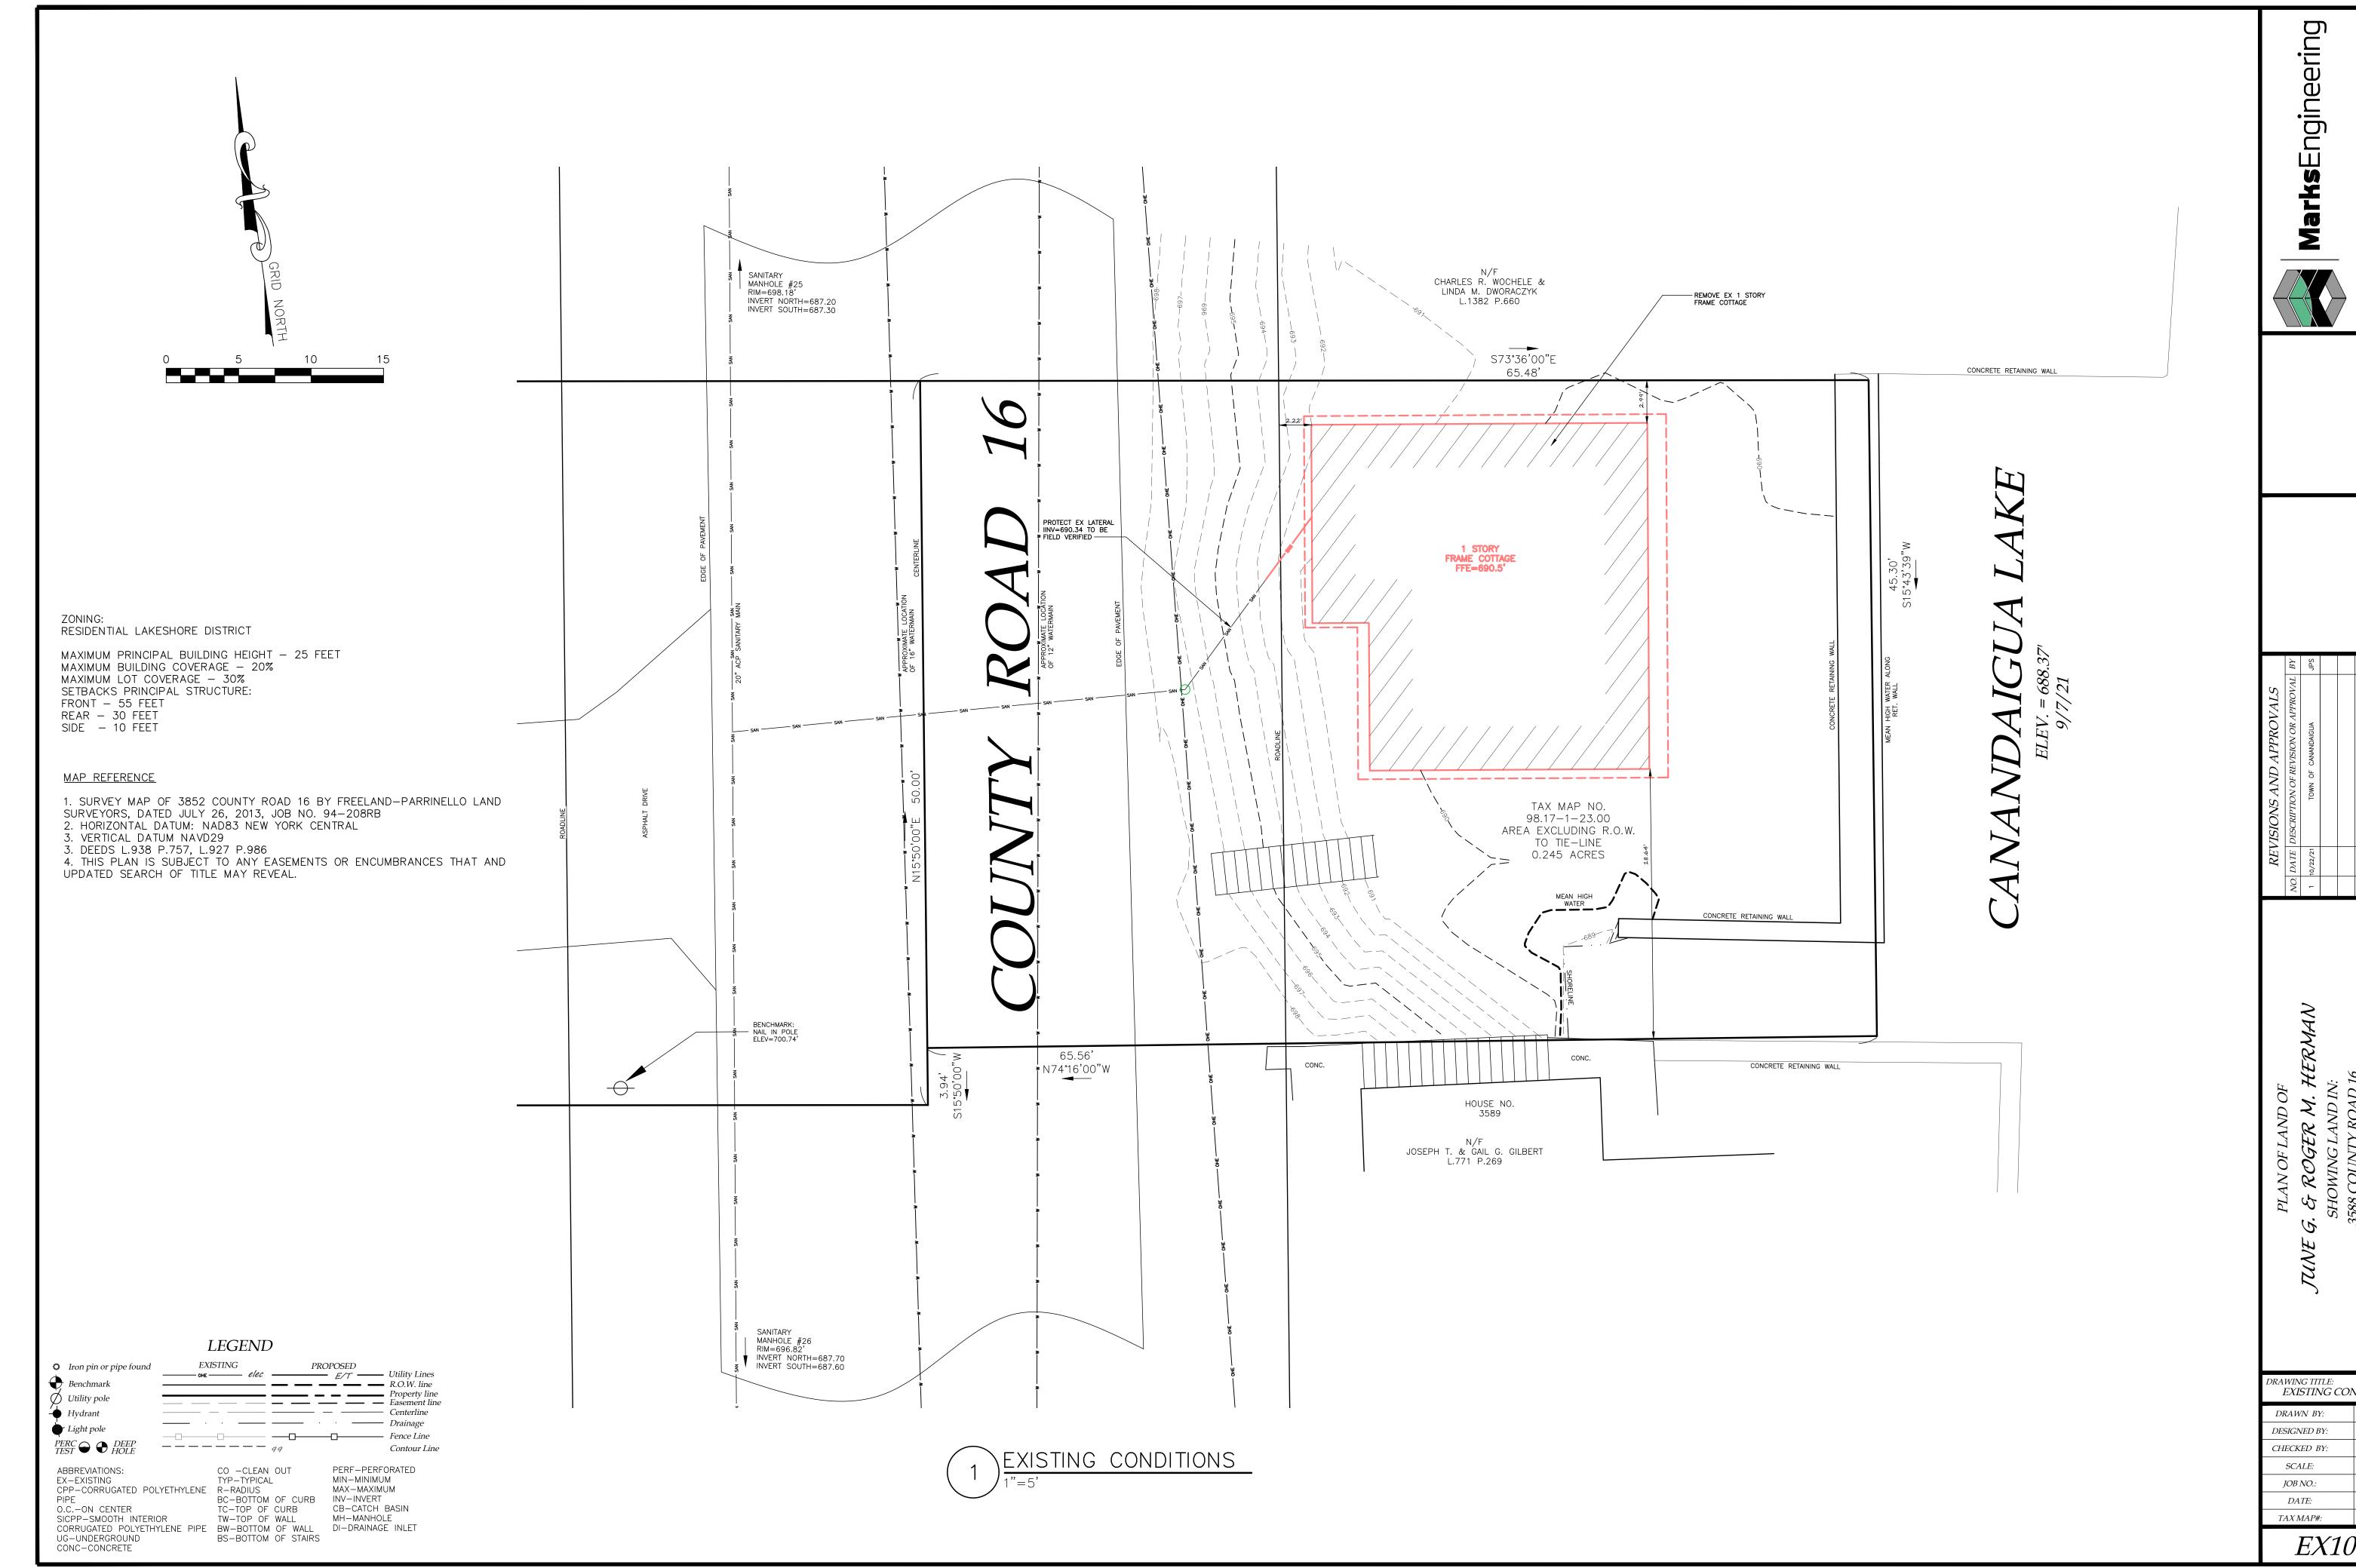



EXISTING CONDITIONS DMP1"=5' 21-143 10/06/2021 98.17-1-23.0


EX100

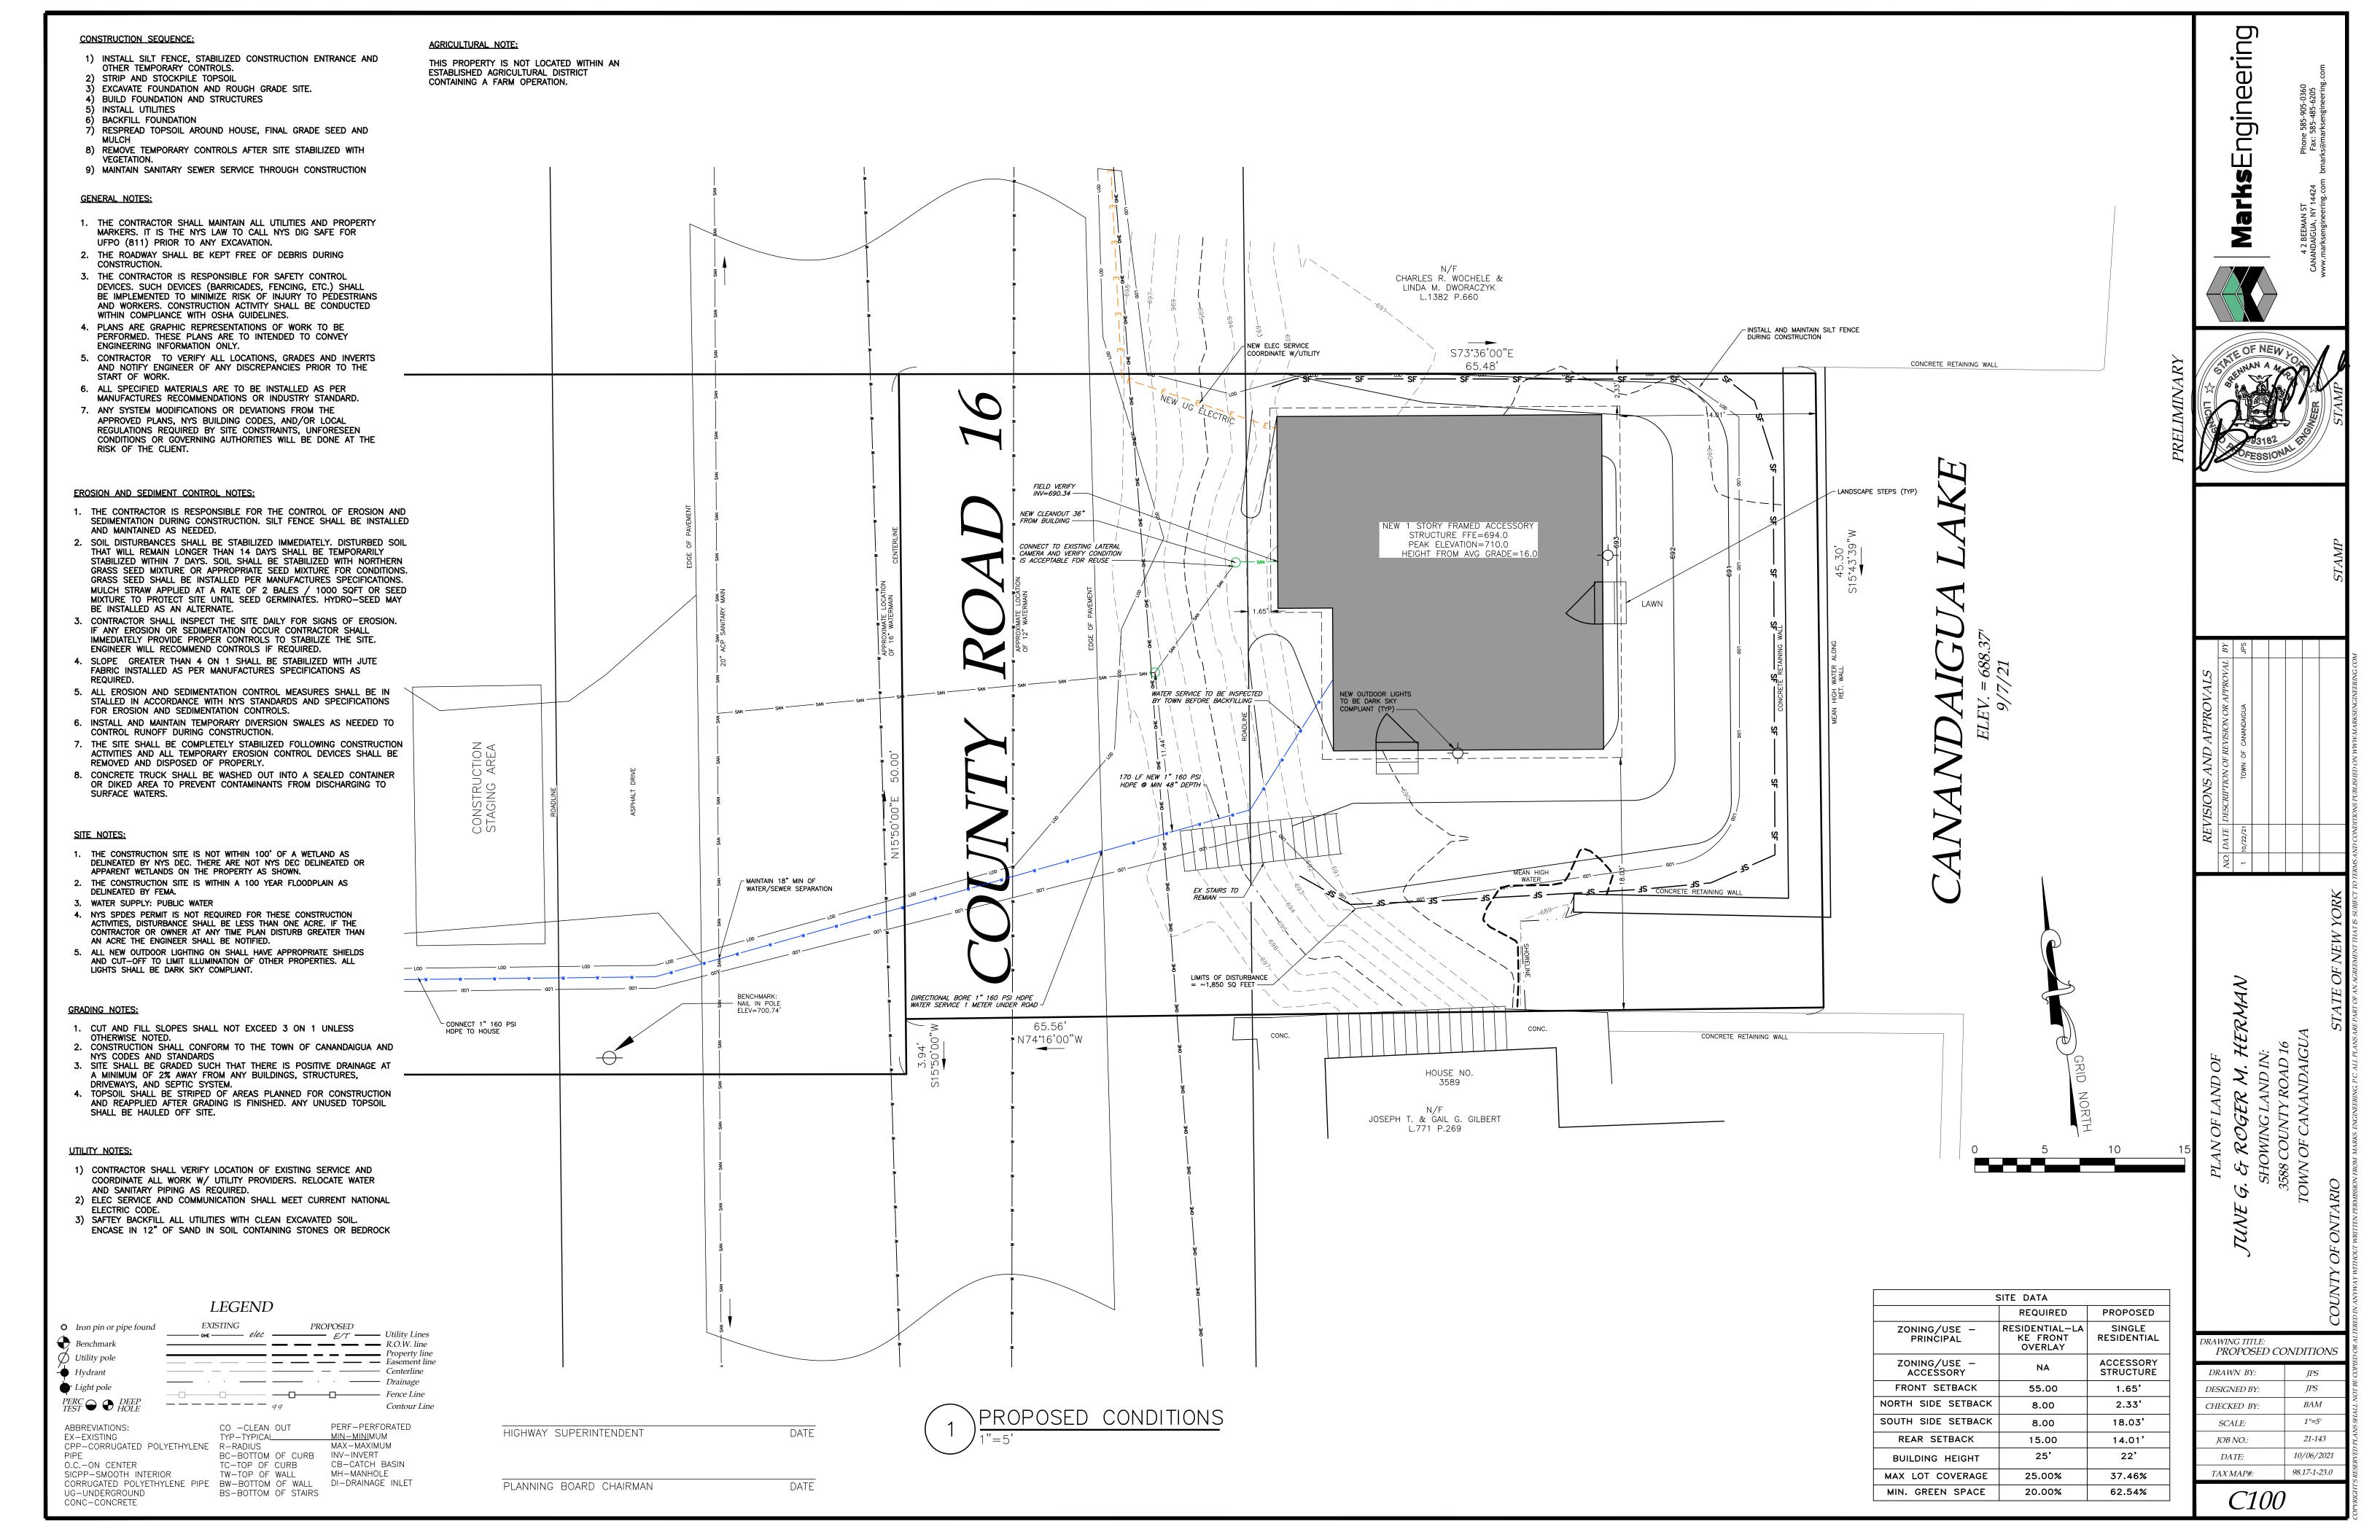

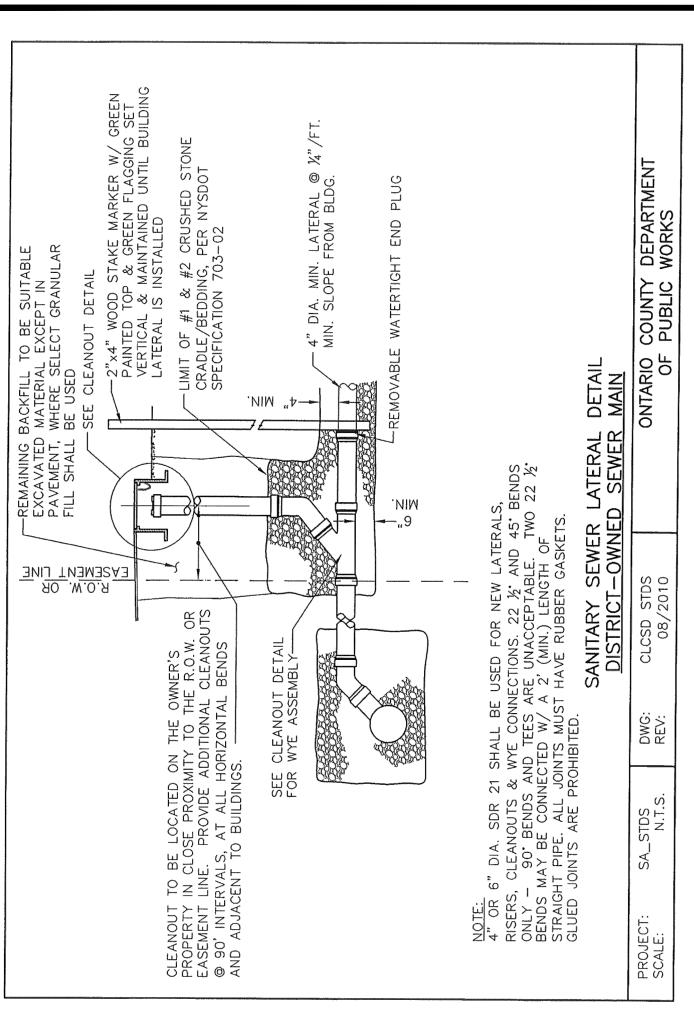

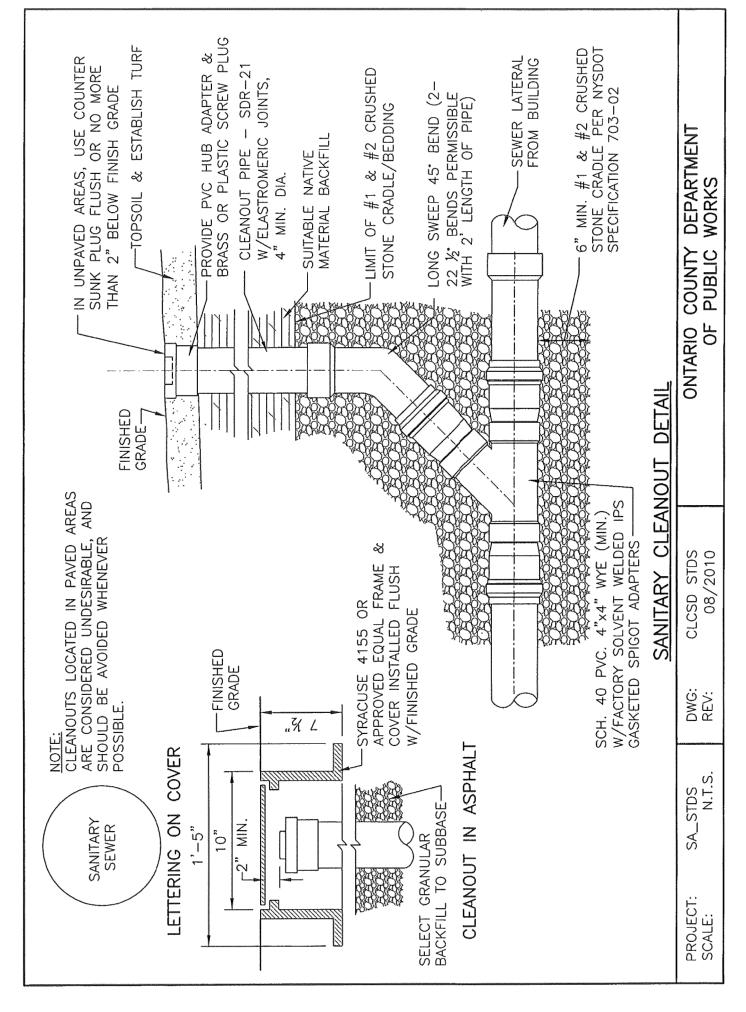

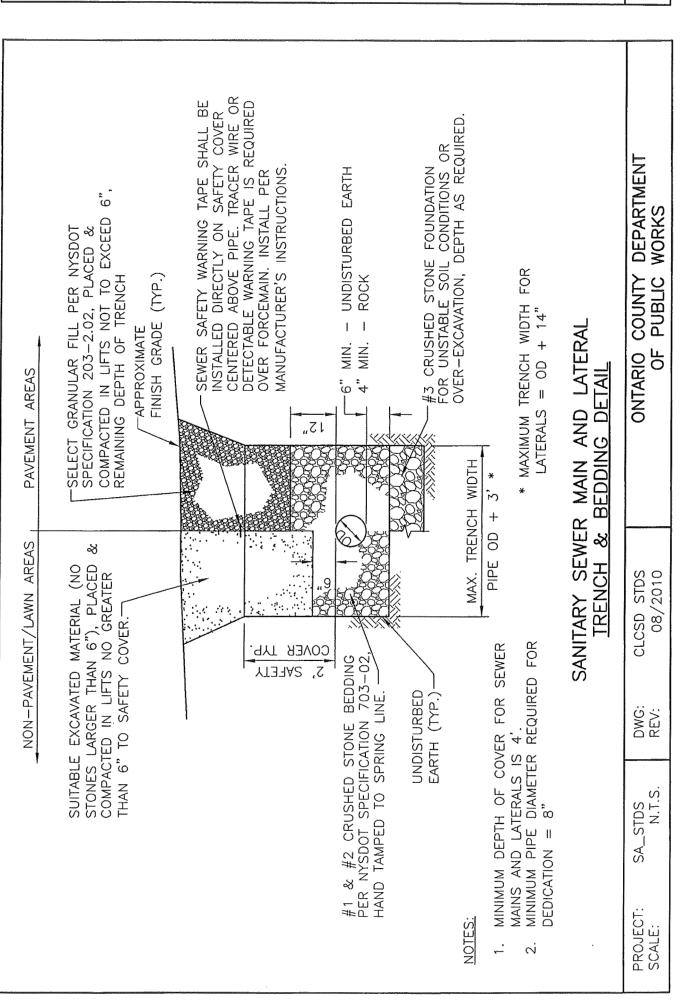

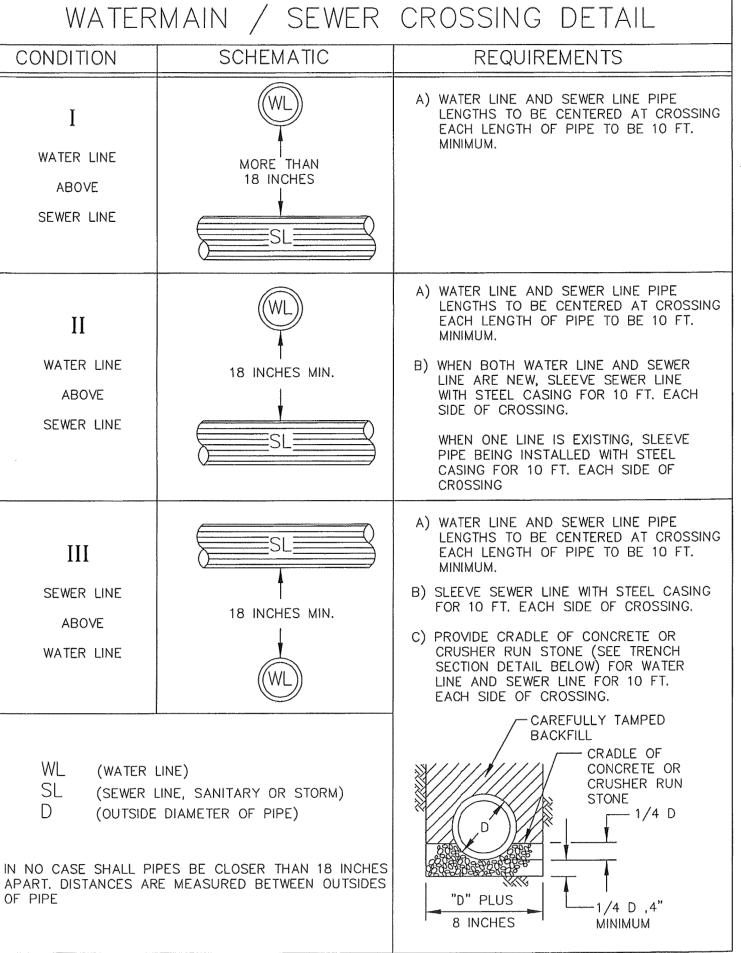

#### SANITARY LATERAL NOTES


#### **ALL PROJECTS**

- All sanitary sewer construction and/or improvements shall be in accordance with the most recent standards and specifications of the Canandaigua Lake County Sewer District, N.Y.S. Department of Environmental Conservation, N.Y.S. Department of Health, the latest edition of <u>Recommended Standards For Wastewater Facilities</u> and any other agencies having jurisdiction.
- 2. No sanitary sewer-related work may be performed without first obtaining a written permit from the Canandaigua Lake County Sewer District.
- 3. District personnel shall be notified a minimum of 48 hours prior to beginning any sanitary sewer-related work.
- 4. The contractor shall locate, mark and preserve any right of way monuments or survey control in the area of construction.
- 5. Utility locations shown are approximate only. The contractor shall determine exact location of utilities, excavating to expose the utility, if necessary in the area of construction, before commencing construction. Contact U.F.P.O. at 1-800-962-7962 at least 72 hours prior to beginning work.
- 6. Laterals shall be min. 4" dia. SDR-21 with elastomeric joints; for commercial establishments, laterals are to be 6" dia. SDR-21. Minimum depth of burial is four feet. Cleanouts shall be installed within 30 inches of the outside face of buildings, at all changes in horizontal alignment, at the right of way or easement line, and at spacing not to exceed 90 feet.
- 7. Sewer mains and laterals shall be located a minimum horizontal distance of ten feet from any existing or proposed watermain (as measured from the outside of the sewer/lateral to the outside of the watermain). In cases where the main or lateral crosses a watermain, the minimum vertical separation shall be eighteen inches (measured out-to-out). The crossing shall be arranged so that the sewer joints will be equidistant and as far as possible from the watermain joints.
- 8. The contractor shall provide the District with shop drawings and material specifications that have been pre-approved by the design engineer before a permit will be issued.
- 9. The contractor is responsible for compliance with OSHA requirements in all aspects of construction.
- 10. The contractor shall be responsible for maintaining sanitary flows at all times by methods acceptable to the District.
- 11. Floor drains in basements or garages are to be connected to the sanitary sewer. Floor drains do not include foundation or footer drains installed to intercept uncontaminated groundwater. All discharges to the sanitary sewer must comply with effluent limits of the Ontario County Sewer Use Law. Foundation and footer drains shall be constructed in a manner that prohibits groundwater from draining into the sanitary sewer pipe cradle.
- 12. Lateral connections requiring openings in asbestos cement pipe will be designed, inspected and certified by the design engineer or representative thereof.
- 13. Any excavation not backfilled by the end of the workday shall be fenced, barricaded and lighted for safety and protection of the public.
- 14. The contractor shall be responsible for the removal of existing sanitary mains, structures and appurtenances, if any, needed to complete the work.

### RENOVATION PROJECTS ONLY


- 15. Existing laterals to be disconnected must be permanently plugged or capped at the easement or right of way line under the direction of Canandaigua Lake County Sewer District personnel.


  The location of the plug or cap shall be recorded for as-built drawing purposes.
- 16. Prior to demolishing an existing building, the contractor shall excavate, disconnect and abandon the lateral from the building to the point of disconnection (approximately 30' from the existing building) per District standards. A temporary plug shall be installed in the remaining portion of the existing sanitary lateral until it is tested and televised.
- 17. In order to determine whether an existing sanitary lateral is acceptable for connection to a new building, the lateral shall be televised in the presence of District personnel at the owner's expense.
- 18. If an existing lateral is found to be acceptable and meet the minimum District requirements, it shall be temporarily re-plugged and backfilled with a witness stake in place, until connection to the new building can take place.
- 19. If a new sanitary sewer lateral is required, the existing lateral must be excavated, removed and capped at the easement or right of way line in accordance with District requirements.
- 20. If a new sanitary sewer lateral is required, the connection to the existing sanitary main shall be made per District standards.

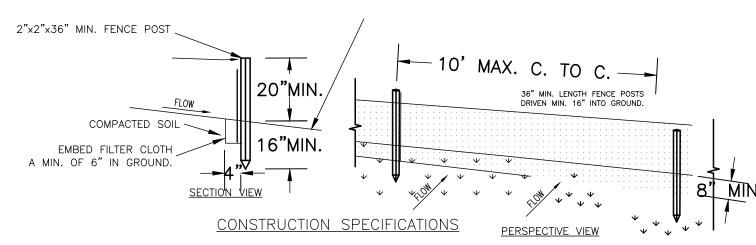

- 1. WOVEN WIRE FENCE TO BE FASTENED SECURELY TO FENCE POSTS WITH WIRE TIES OR STAPLES. POSTS SHALL BE STEEL EITHER "T" OR "U" TYPE OR HARDWOOD.
- 2. FILTER CLOTH TO BE TO BE FASTENED SECURELY TO
- 3. WHEN TWO SECTIONS OF FILTER CLOTH ADJOIN EACH OTHER THEY SHALL BE OVER—LAPPED BY SIX INCHES AND FOLDED. FILTER CLOTH SHALL BE EITHER FILTER X, MIRAFI 100X, STABILINKA T140N, OR APPROVED EQUIVALENT.
- 4. PREFABRICATED UNITS SHALL BE GEOFAB, ENVIRONMENT, OR APPROVED EQUIVALENT.
- 5. MAINTENANCE SHALL BE PERFORMED AS NEEDED AND MATERIAL REMOVED WHEN "BULGES" DEVELOP IN THE SILT FENCE.



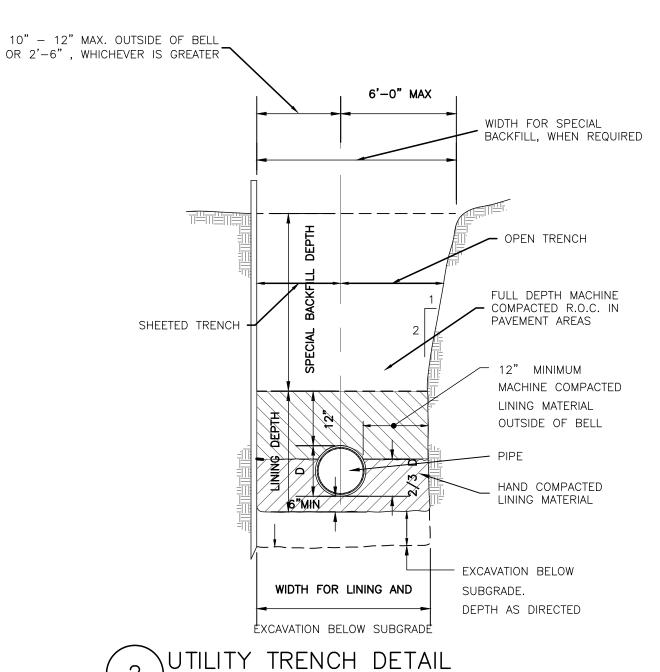

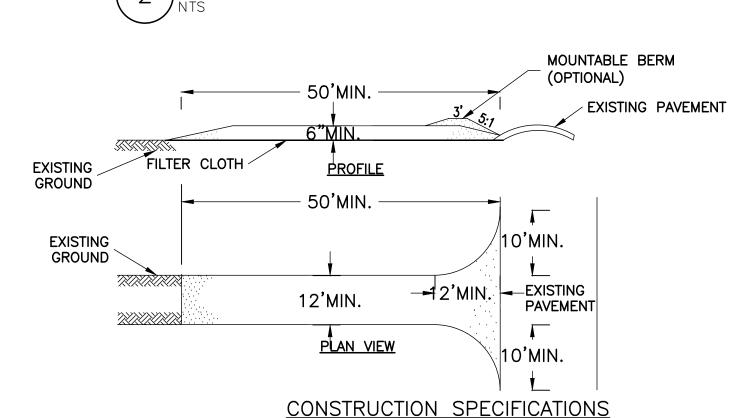

- 1. STONE SIZE USE 2" STONE, OR RECLAIMED OR RECYCLED CONCRETE EQUIVALENT.
  2. LENGTH NOT LESS THAN 50 FEET (EXCEPT ON A SINGLE GARAGE LOT WHERE
- A 30 FOOT MINIMUM LENGTH WOULD APPLY).
- 3. THICKNESS NOT LESS THAN SIX (6) INCHES.

  4. WIDTH TWELVE (12) FOOT MINIMUM, BUT NOT LESS THAN THE FULL WIDTH AT POINTS WHERE INGRESS OR EGRESS OCCURS. TWENTY—FOUR (24) FOOT IF SINGLE ENTRANCE TO SITE.

  5. FILTER CLOTH WILL BE PLACED OVER THE ENTIRE AREA PRIOR TO PLACING OF
- 6. SURFACE WATER ALL SURFACE WATER FLOWING OR DIVERTED TOWARD CONSTRUCTION ENTRANCES SHALL BE PIPED ACROSS THE ENTRANCE. IF PIPING IS IMPRACTICAL, A MOUNTABLE BERM WITH 5:1 SLOPES WILL BE PERMITTED.

  7. MAINTENANCE THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION WHICH WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RIGHTS—OF—WAY, ALL SEDIMENT SPILLED, DROPPED, WASHED OR TRACTED ONTO PUBLIC RIGHTS—OF—WAY MUST BE REMOVED IMMEDIATELY.
- 8. WHEN WASHING IS REQUIRED, IT SHALL BE DONE ON A AREA STABILIZED WITH STONE AND WHICH DRAINS INTO AN APPROVED SEDIMENT TRAPPING DEVICE.

  9. PERIODIC INSPECTION AND NEEDED MAINTENANCE SHALL BE PROVIDED AFTER EACH RAIN.

3 STABILIZED CONSTRUCTION ENTRANCE

APPROVAL BY
APPROV

Engineering

Marks

NO. DATE DESCRIPTION OF REVISION OR APPROVAL BY
1 10/22/21 TOWN OF CANANDAIGUA JPS
W YORK

5 ROGER M. HERMAN HOWING LAND IN: 8 COUNTY ROAD 16 N OF CANANDAIGUA

Ĝ.

DRAWING TITLE:
DETAILS

DRAWN BY:
DESIGNED BY:
CHECKED BY:
BAM
SCALE:
AS NOTED

 JOB NO.:
 21-143

 DATE:
 10/06/2021

 TAX MAP#:
 98.17-1-23.0