



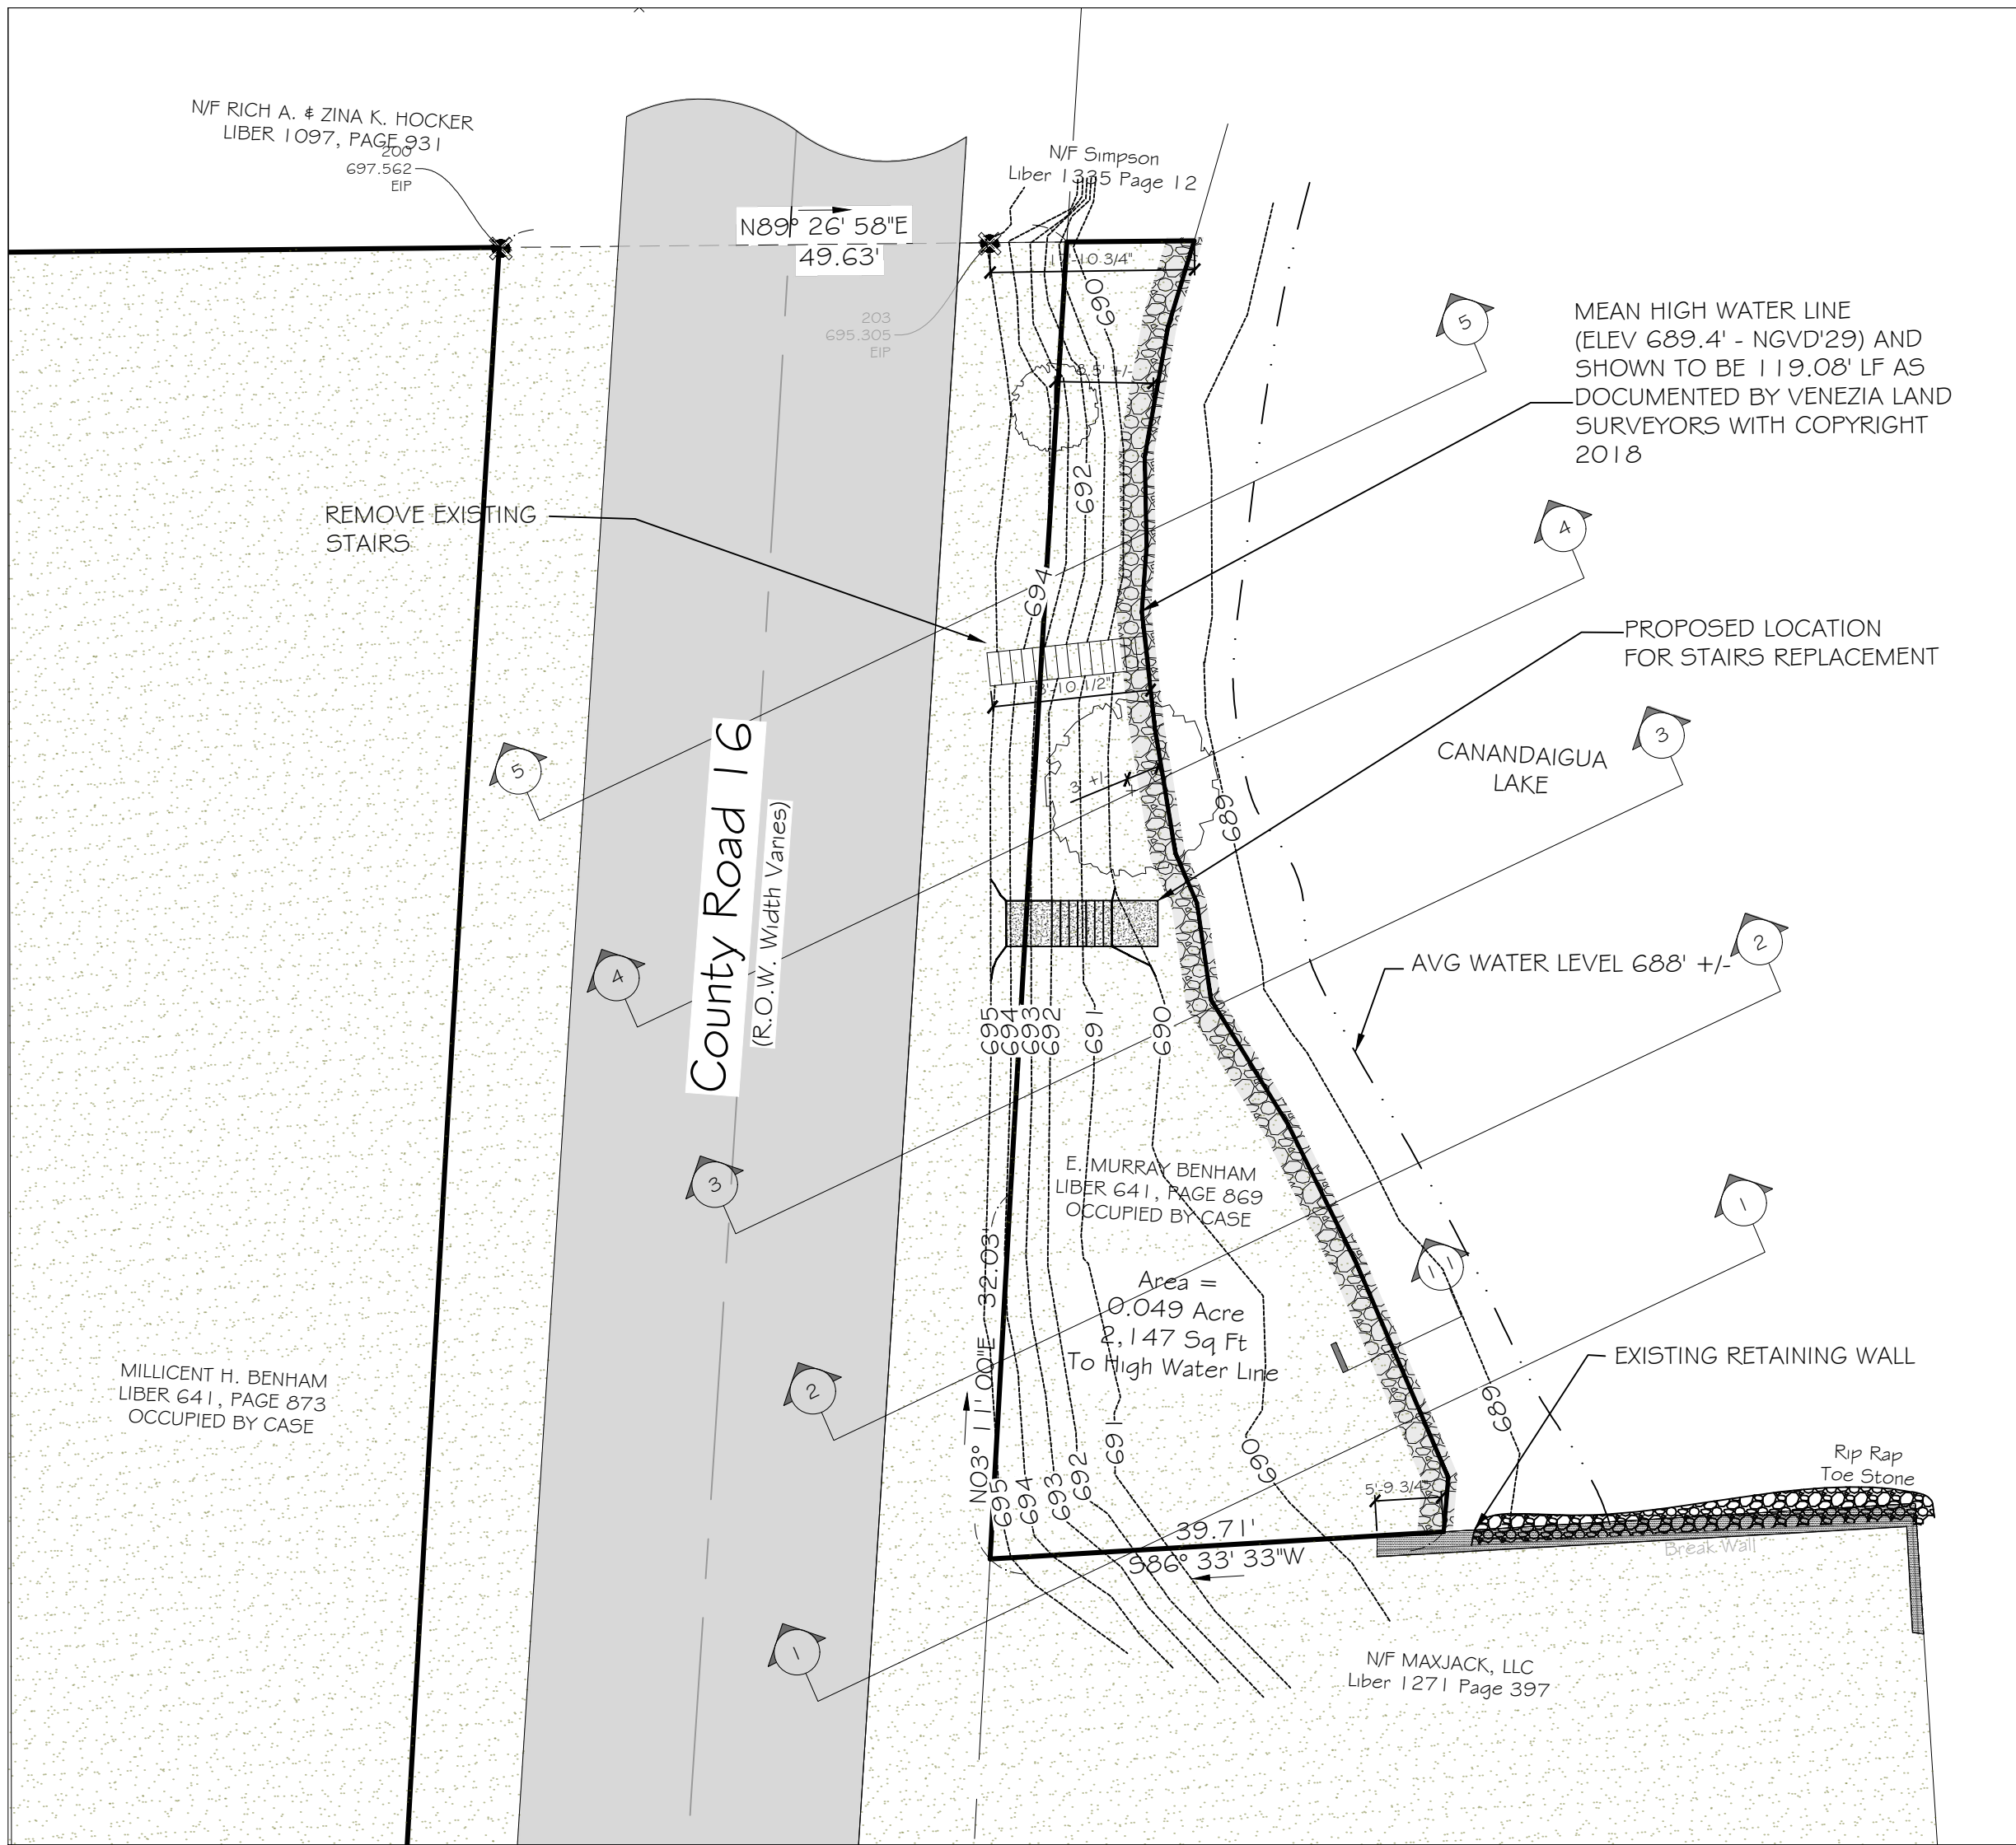


SHORELINE RECONSTRUCTION


SCALE: N.T.S.

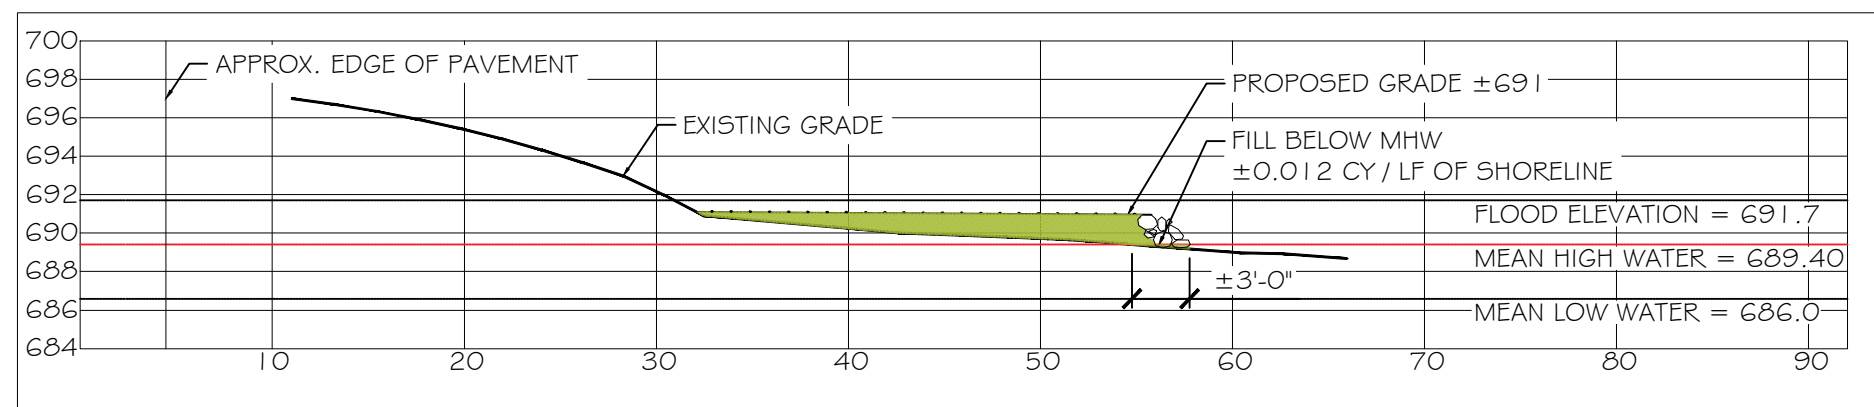


① SHORELINE SECTION
SCALE: 1:10

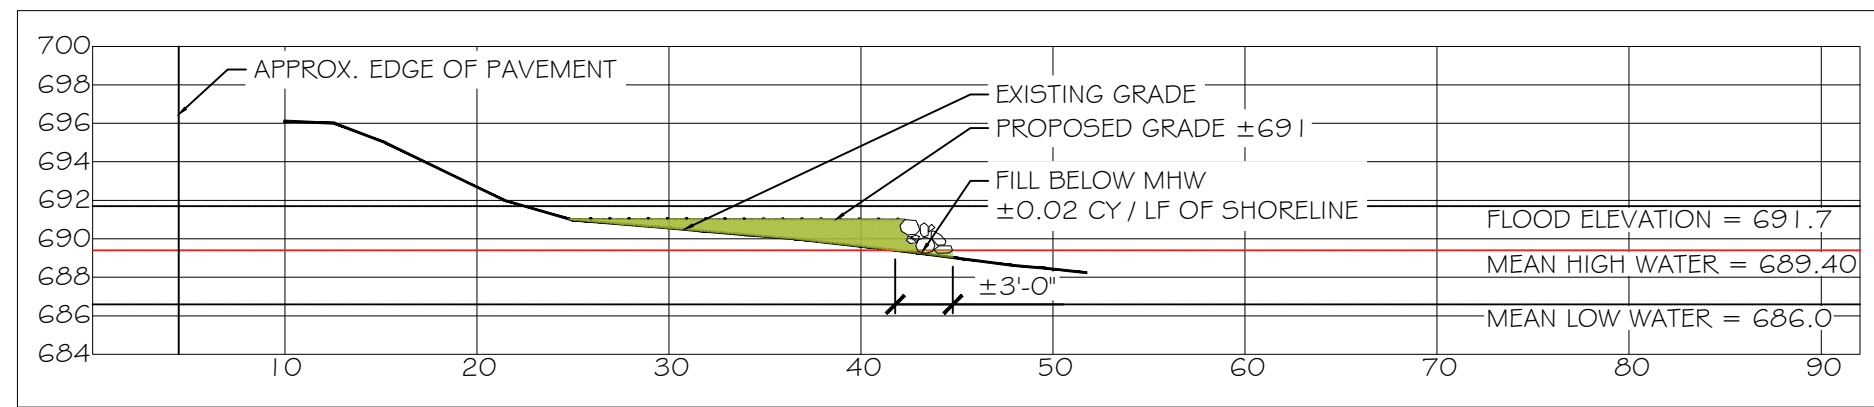


② SHORELINE SECTION
SCALE: 1:10

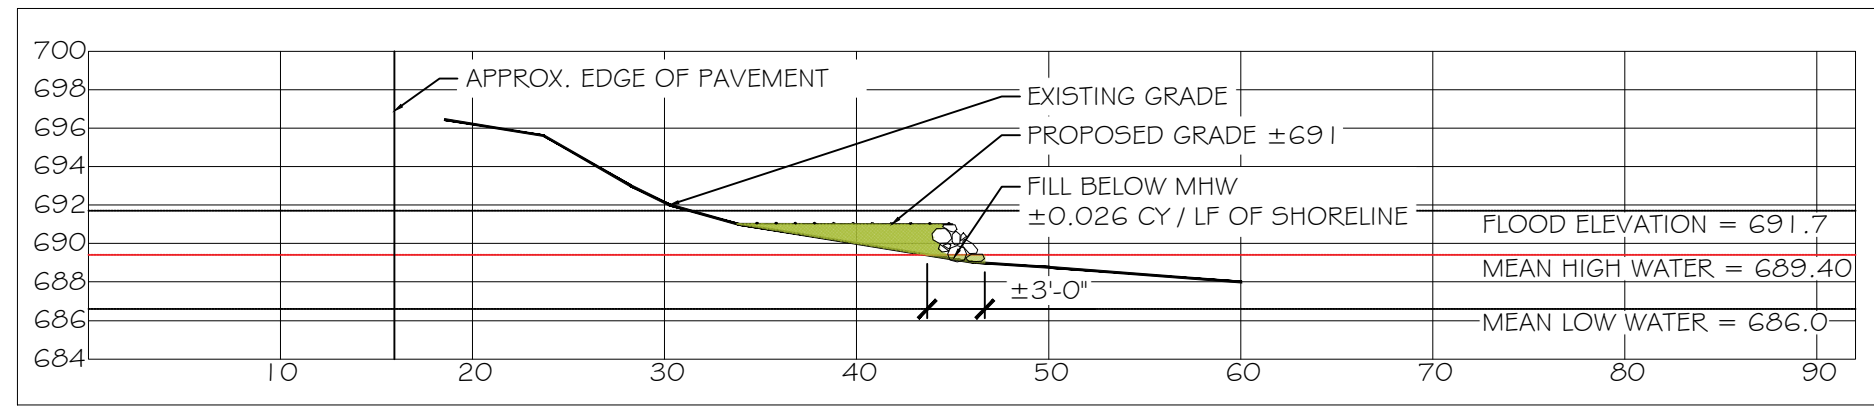


③ SHORELINE SECTION
SCALE: 1:10

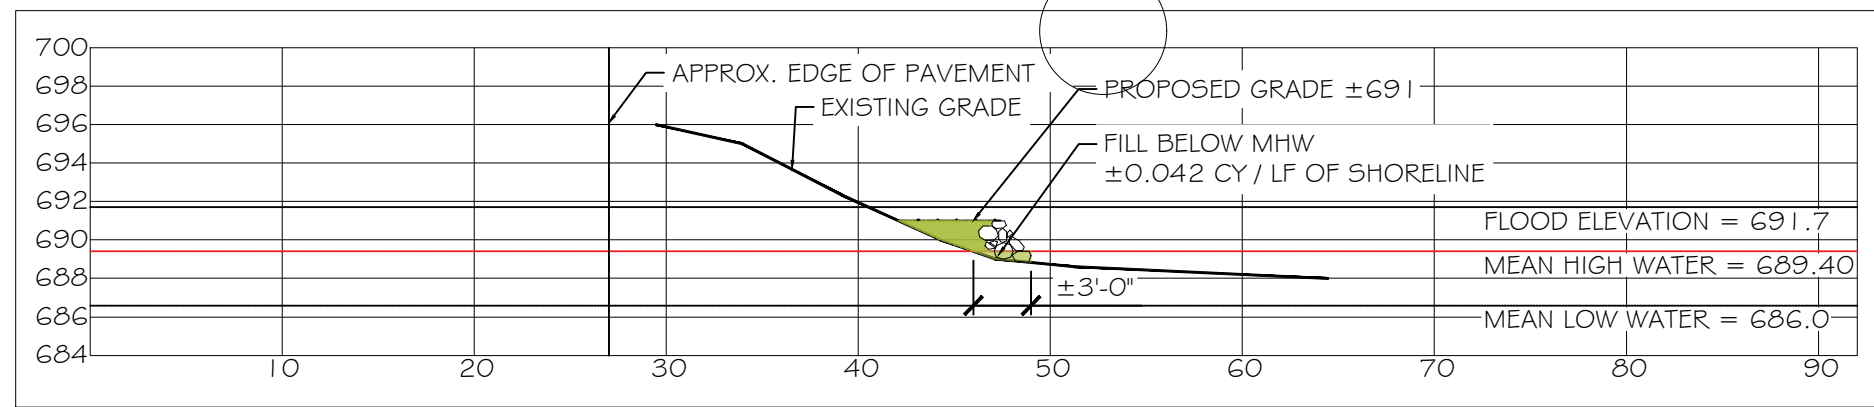

④ SHORELINE SECTION
SCALE: 1:10

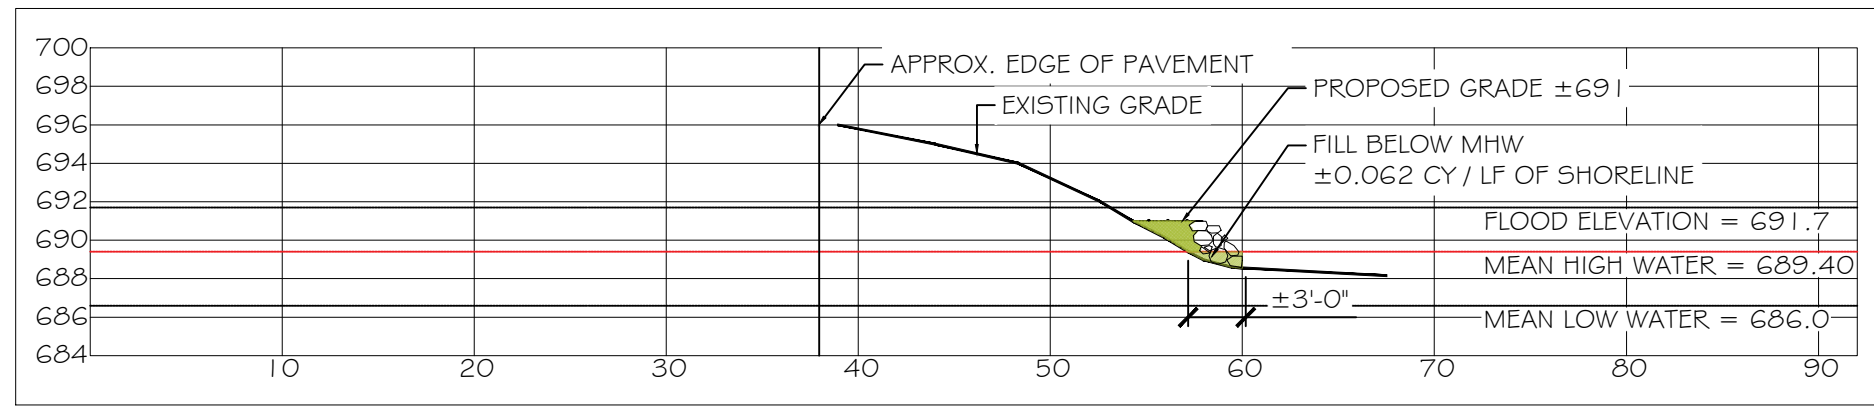


⑤ SHORELINE SECTION
SCALE: 1:10

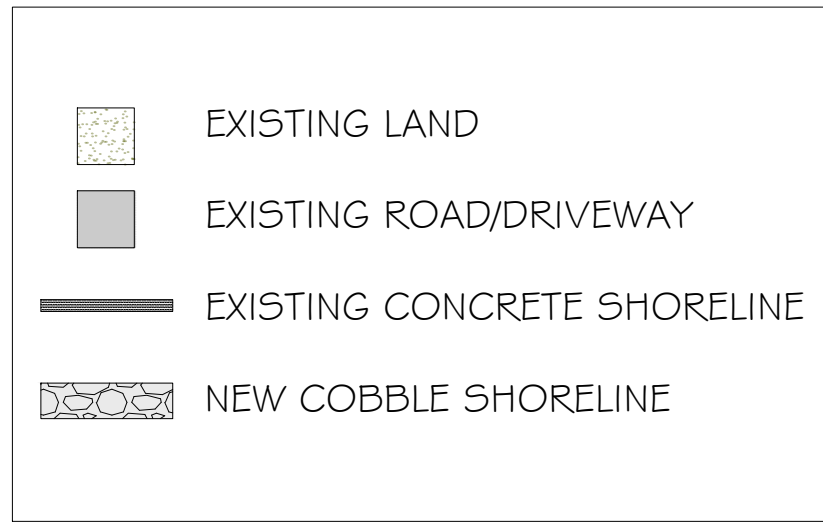


CONCRETE & FOUNDATION NOTES


1. CONCRETE WORK, CONSTRUCTION AND REINFORCING DETAILS SHALL CONFORM TO THE SPECIFICATIONS OF THE AMERICAN CONCRETE INSTITUTE BUILDING CODE REQUIREMENTS (ACI 318).
2. FOUNDATION CONCRETE SHALL ATTAIN A MINIMUM COMPRESSIVE STRENGTH OF 3,000 PSI (AIR ENTRAINED) AT 28 DAYS.
3. REINFORCING STEEL SHALL CONFORM TO ASTM A615 GRADE 60. LAP SPLICES AND EMBEDMENT LENGTHS SHALL CONFORM TO ACI 318, CHAPTER 12. PROVIDE CORNER BARS TO MATCH HORIZONTAL REINFORCING WHERE WALLS OR BEAMS MEET AT CORNERS OR INTERSECT. THIS ALSO INCLUDES INTERSECTIONS OF CONCRETE WITH MASONRY WORK.
5. PROVIDE SHOP DRAWINGS FOR REINFORCING INCLUDING ALL NECESSARY ACCESSORIES.
6. SPREAD FOOTINGS SHALL REST ON UNDISTURBED SOIL COMPACTED ENGINEERED FILL OR SOLID ROCK HAVING A MINIMUM BEARING CAPACITY OF 3,000 PSF. BEARING CAPACITY OF SUBGRADE SHALL BE VERIFIED BY A QUALIFIED GEOTECHNICAL ENGINEER.
7. IN GENERAL, EXTERIOR CONSTRUCTION SHALL BE CARRIED DOWN A MINIMUM OF 4'-0" BELOW FINISHED EXTERIOR GRADE UNLESS NOTED OTHERWISE. (2'-0" MINIMUM AT ROCK BEARING WITHOUT POSSIBILITY OF FROST HEAVE).
8. ALL FOOTINGS SHALL BE CENTERED UNDER SUPPORTED MEMBERS, UNLESS NOTED OTHERWISE.
9. ANCHOR BOLTS: ASTM A307.

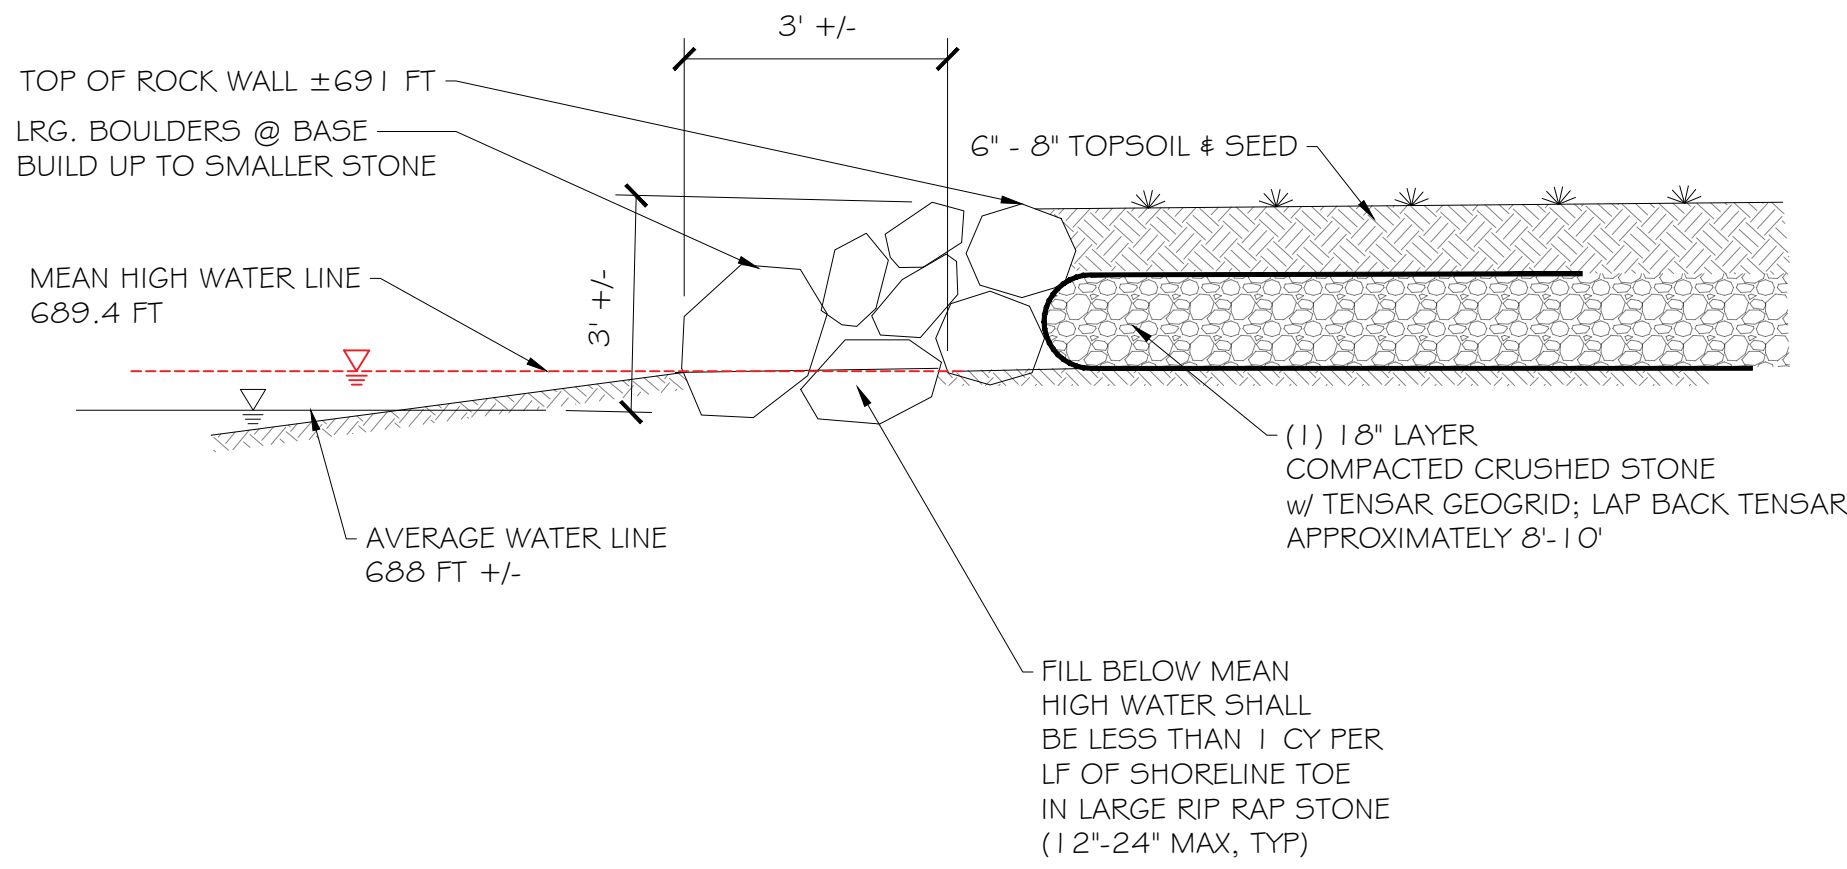

1.1 NEW COBBLE SHORELINE
SCALE: N.T.S.

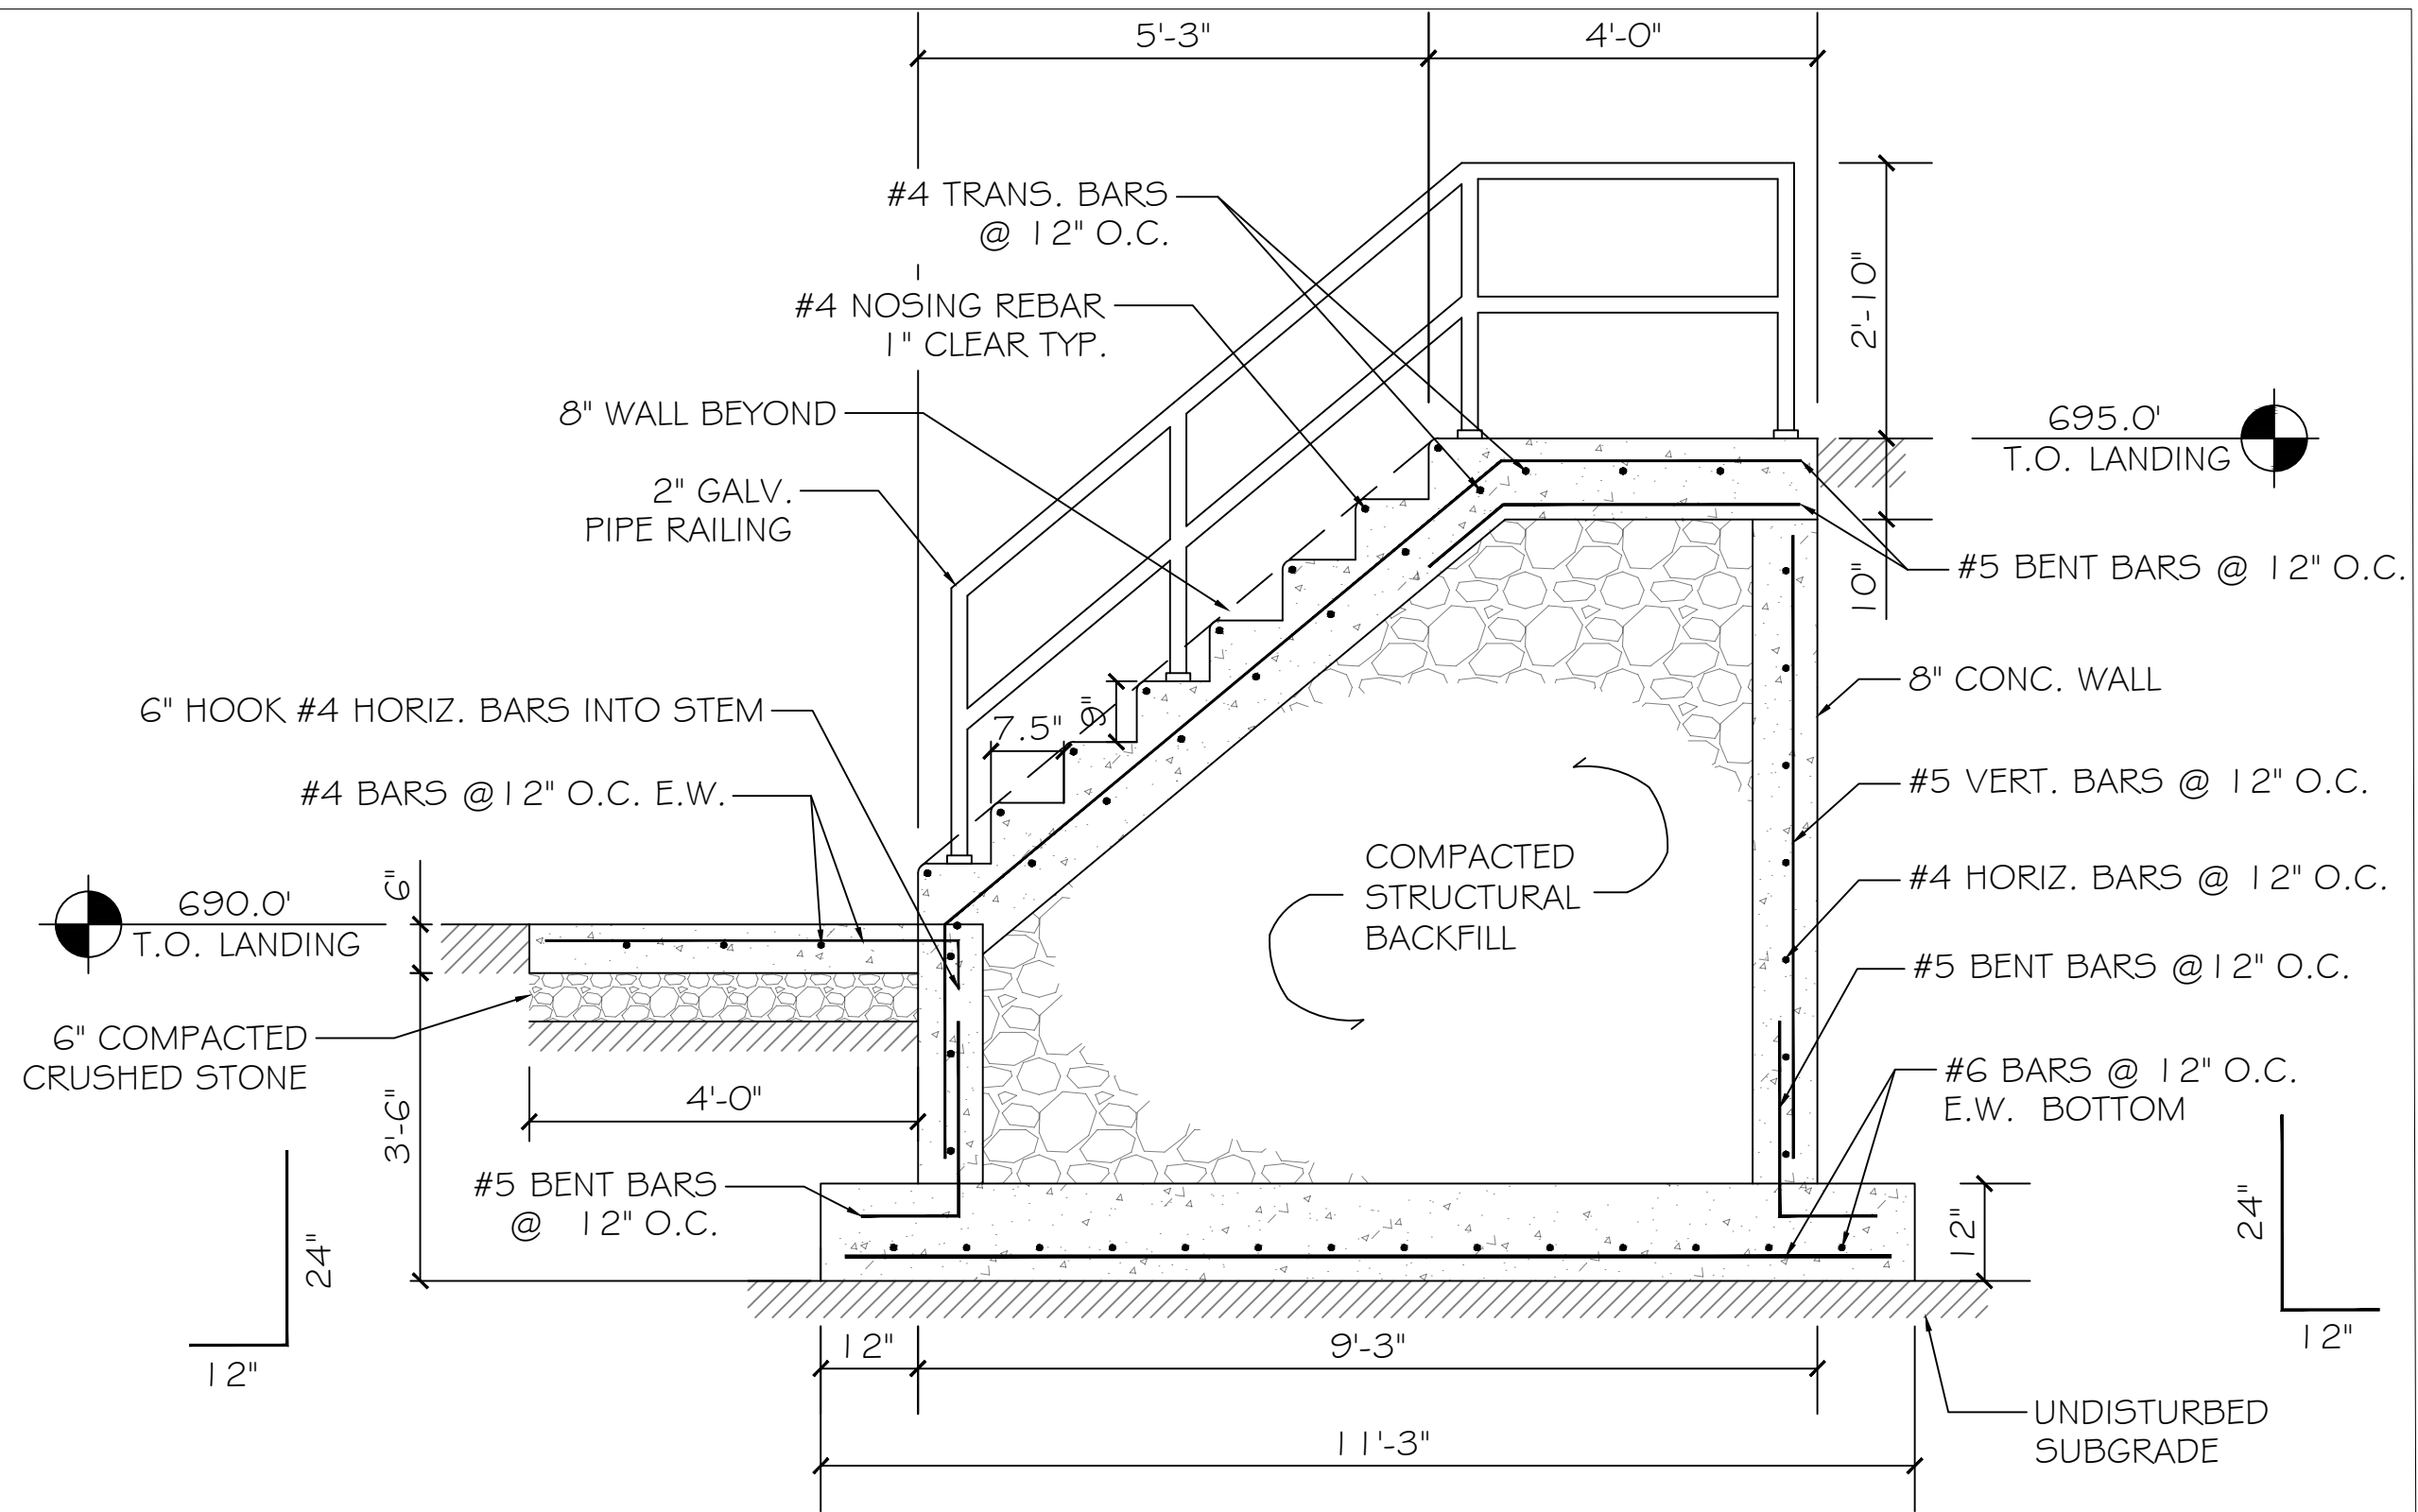

SECTION A-A
SCALE: N.T.S.

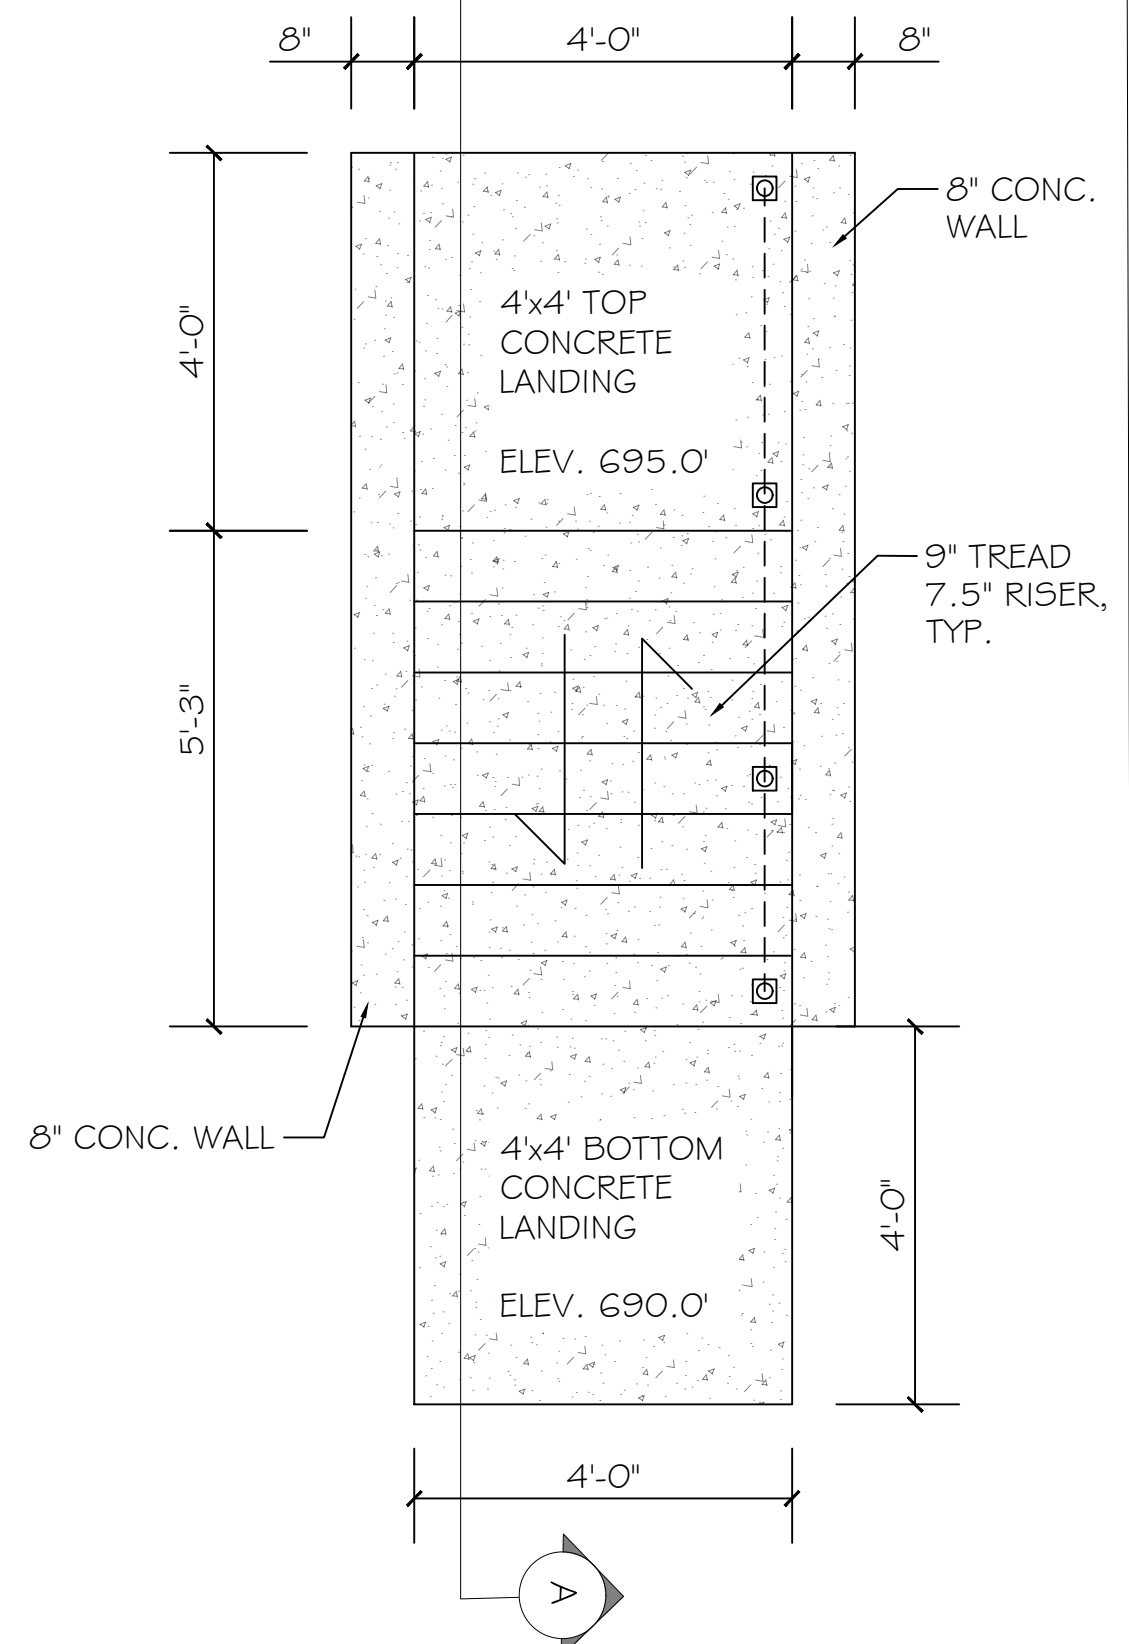

STAIRS-PLAN VIEW
SCALE: N.T.S.



LOCATION PLAN
SCALE: N.T.S.


OWNER	DATE
PLANNING BOARD CHAIRPERSON	DATE
BUILDING DEPARTMENT	DATE
TOWN ENGINEER	DATE

COPYRIGHT PROTECTION
UNAUTHORIZED ALTERATIONS OR REVISIONS OF THIS DRAWING ARE STRICTLY PROHIBITED. ANY SUCH VIOLATIONS OF THESE TERMS SHALL BE CONSIDERED A BREACH OF CONTRACT AND SHALL BE SUBJECT TO THE PENALTIES AND REMEDIES PROVIDED IN THE MEASHER ENGINEERING, PLLC 2019

REVISIONS:		DATE
F	STAIR RELOCATION	8.15.19
E	REVISED PER NYSDEC	6.10.19
D	REVISED PER NYSDEC	4.29.19
C	REVISED PER NYSDEC	4.29.19
B	REVISED PER NYSDEC	4.29.19
A	REVISED PER NYSDEC	4.29.19

JOB NO. 16911	BLH	AS NOTED
DRAWN: 8/15/2019	DATE: 8/15/2019	SCALE: AS NOTED
CHECKED: WLM	DATE: 8/15/2019	SCALE: AS NOTED

UNAUTHORIZED ALTERATIONS OR REVISIONS OF THIS DRAWING ARE STRICTLY PROHIBITED. ANY SUCH VIOLATIONS OF THESE TERMS SHALL BE CONSIDERED A BREACH OF CONTRACT AND SHALL BE SUBJECT TO THE PENALTIES AND REMEDIES PROVIDED IN THE MEASHER ENGINEERING, PLLC 2019

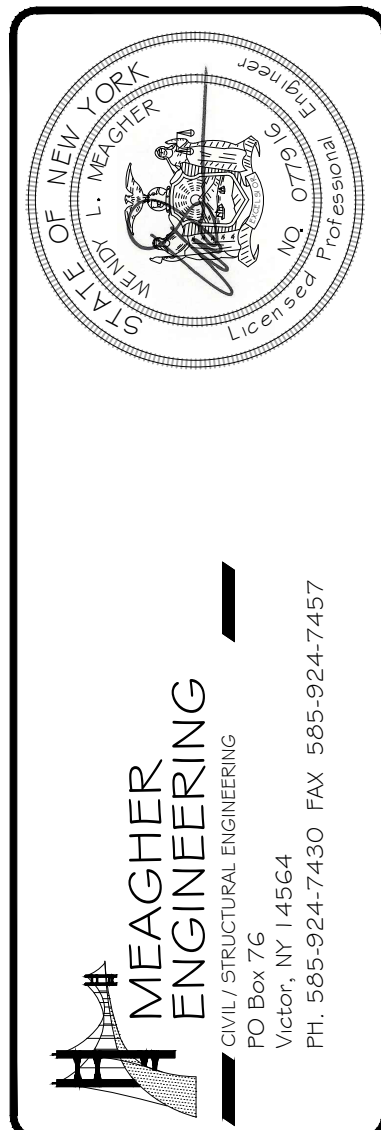

CLIENT:	JOHN CASEY 3814 WEST LAKE ROAD CANANDAIGUA, NY 14424
PROJECT:	SHORELINE RECONSTRUCTION
DRAWING:	SITE PLAN

DRAWING NO.	C-1
1 of 1	