


SPECIFICATIONS LEGEND:

1. BUILDING TO SEPTIC TANK - 4" PVC ASTM-3034, SDR 21 OR SCHEDULE 40. PIPE SHALL BE INSTALLED AT A MINIMUM SLOPE OF 1/4" PER FOOT ON A COMPACTED SUB-BASE WITH A MINIMUM 4" CRUSHED STONE OR SAND ENCASEMENT. THERE SHALL BE NO BENDS IN THE PIPE BETWEEN THE BUILDING AND THE SEPTIC TANK WITHOUT A CLEAN OUT.
2. LAUNDRY FACILITIES WASTE SHALL DISCHARGE TO THE SEPTIC TANK. IF A FORCED SYSTEM IS USED, THE DISCHARGE SYSTEM SHALL INCLUDE A CHECK VALVE.
3. SEPTIC TANK SHALL COMPLY WITH SECTION 75-A OF THE CURRENT NYSDOH REGULATIONS. TANK SHALL BE DUAL COMPARTMENT WITH A CAPACITY OF 1500 GALLONS AND A MINIMUM LIQUID SURFACE AREA OF 40 SF. FOR THE BUILDING. THE SEPTIC TANK IS SIZED FOR A CARBAGE GRINDER, HOWEVER, ONE IS NOT RECOMMENDED. AN EFFLUENT FILTER SHALL BE PLACED AT THE TANK OUTLET.
4. THE PIPE FROM THE SEPTIC TANK TO THE DISTRIBUTION BOX SHALL BE THE SAME AS SPECIFICATION #1 INSTALLED AT A MINIMUM SLOPE OF 1/8" PER FOOT. ALL PIPES IN THE SYSTEM SHALL BE PROPERLY ENCASED IN SAND BEFORE BACKFILLING.
5. DISTRIBUTION BOX SHALL COMPLY WITH SECTION 75-A OF THE NYSDOH REGULATIONS. IT SHALL BE INSTALLED ON 12" LEVELING COURSE OR CRUSHED STONE.
6. PERFORATED PIPE DISTRIBUTION LINES SHALL BE 4" PVC PER ASTM-D2729 INSTALLED AT A SLOPE OF 1/16" TO 1/32" PER FOOT INSTALLED PER PLAN DETAIL. THE INFLTRATORS SHALL BE INSTALLED WITH A MAXIMUM COVER OF 8".
7. THE SURFACE STORMWATER SYSTEMS SHALL DISCHARGE WATER AWAY FROM THE WASTEWATER TREATMENT SYSTEM AND TO THE LOW SIDE OF THE AREA TO BE DEVELOPED. STORMWATER DISCHARGES AND TRENCH DRAINS SHALL NOT BE CONNECTED TO THE TREATMENT SYSTEM. ROOF DROPS SHALL DISCHARGE TO SPLASH BLOCKS.
8. WATER SERVICE FROM THE MAIN TO THE ROW SHALL BE A MINIMUM SIZE OF 1" POLYETHYLENE TUBING PE3408 (CTS). ASTM-D3737. SERVICE TO THE HOME CAN BE A MINIMUM OF 1" POLYETHYLENE TUBING PE3408 (CTS). ASTM-D3737 PER PLAN NOTES. SERVICE INSTALLATIONS SHALL BE MADE IN ACCORDANCE WITH THE TOWN OF CANANDAIGUA WATER DEPARTMENT REGULATIONS AND ANY PERMIT CONDITIONS ESTABLISHED. WATER SERVICES SHALL INCLUDE A METER, PRESSURE REGULATOR AND A CHECK VALVE IN THE HOME.
9. WATER SAVING DEVICES PER CURRENT NYS BUILDING CODE SHALL BE INSTALLED ON ALL FIXTURE UNITS DISCHARGING WASTEWATER TO THE TREATMENT SYSTEM.

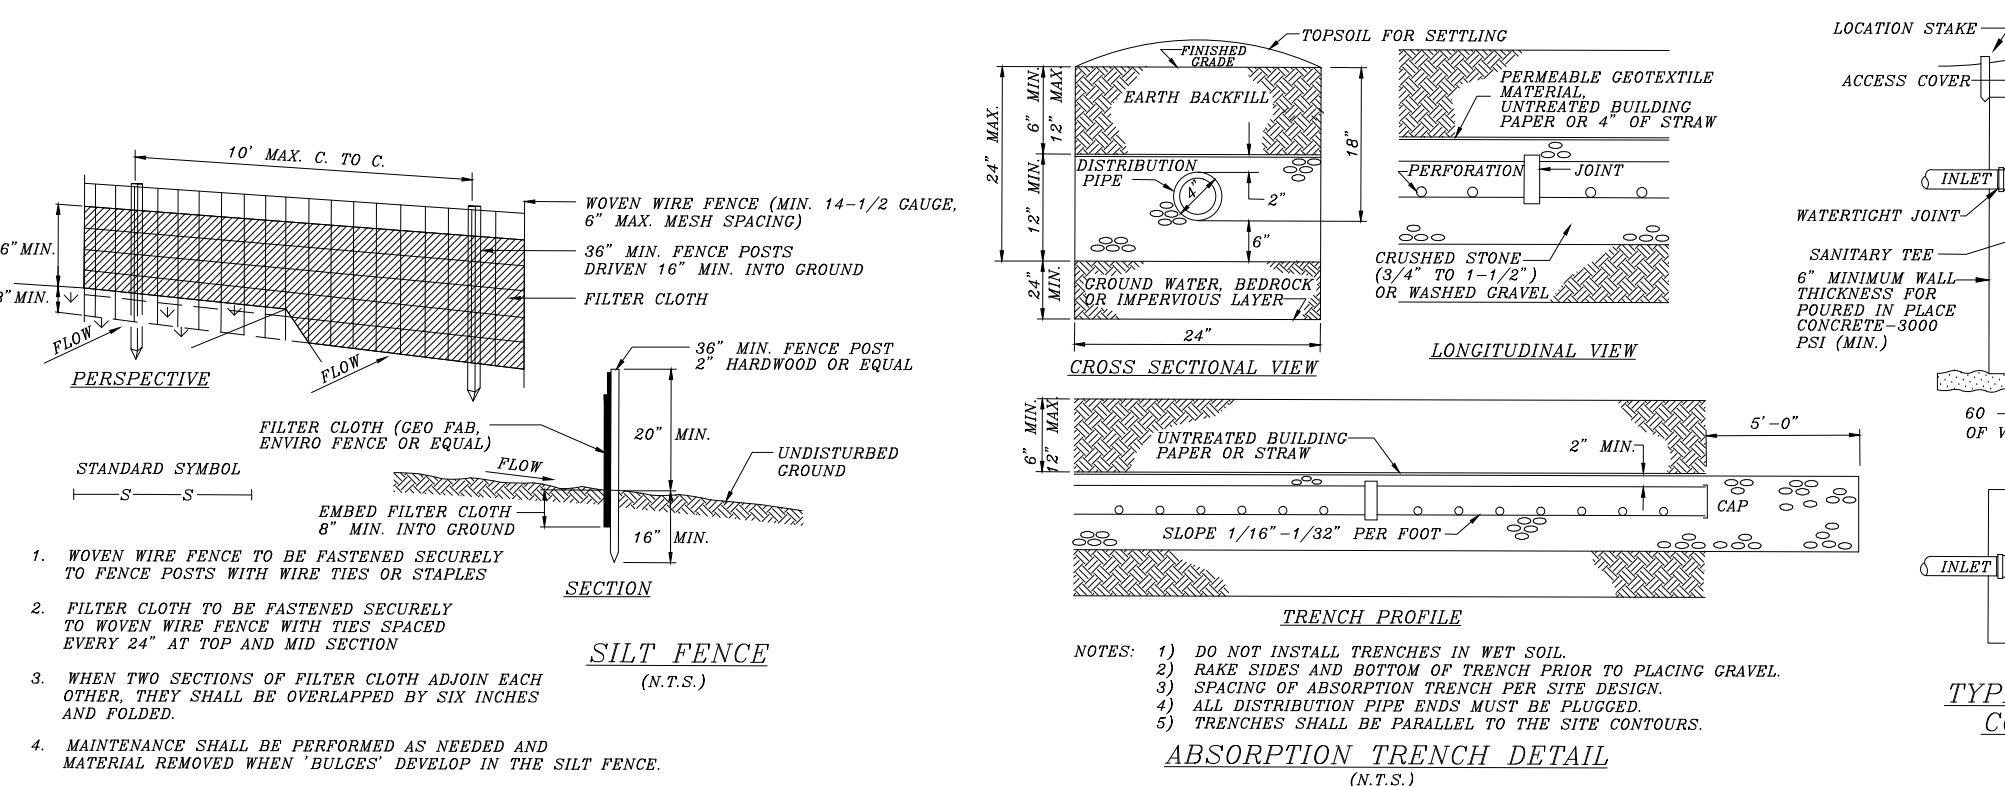

FINAL SITE PLAN (NO PRELIMINARY SITE PLAN REVIEW REQUIRED)

PLANNING BOARD CHAIRPERSON		DATE	
DATE		REVISION	
4	XXXX	X/XX/XX	MSC
3	XXXX	X/XX/XX	MSC
2	XXXX	X/XX/XX	MSC
1	TOWN PRC COMMENTS		6/21/18

PLAN OF LAND TO BE DEVELOPED BY		JESS M. & ADRIANE C. KIDDER	
HOPKINS ROAD		IN	
TOWN OF CANANDAIGUA		NEW YORK	
MAY 29, 2018		JOB NO. 16-3664	
GREENE LAND SURVEYING, PLLC.		315-331-3999	
403 EAST MILLER STREET, NEWARK, NY 14513			