ONE STAGE(PRELIMINARY/FINAL) SITE PLAN SET FOR HML PROPERTIES, LLC 5131 SILVERNAIL DRIVE TOWN OF CANANDAIGUA ONTARIO COUNTY -- STATE OF NEW YORK



AERIAL LOCUS NOT TO SCALE

A P.K. nail found



COVER SHEET


SITE PLAN

SLOPE ANALYSIS SITE DETAILS

ZONING CHART

ZONING DISTRICT: SOUTHERN CORRIDOR RESIDENTIAL (SCR-1)

	REQUIRED	EXISTING	PROVIDED
MIN LOT AREA (AREA TO ROW)	1 ACRE	10.138 ACRES	NO CHANGE
MIN LOT WIDTH	125'	30.0' FLAG LOT	NO CHANGE
MIN FRONT YARD SETBACK	60'	N/A	N/A
MIN SIDE YARD SETBACK	25'	N/A	53.9'
MIN REAR YARD SETBACK	40'	N/A	530'
MAX BUILDING HEIGHT	35 FT	N/A	MAX 35 FT
MAX BUILDING COVERAGE	20%	N/A	1%
SITE DISTURBANCE	175,400 SF		



GENERAL NOTES

1. PROPERTY LINE INFORMATION SHOWN ON THIS PLAN IS BASED ON AVAILABLE RECORD

2. UTILITIES SHOWN ON THIS PLAN ARE APPROXIMATE. $\,$ ACTUAL LOCATION SHALL BE FIELD VERIFIED PRIOR TO CONSTRUCTION. THE CONTRACTOR SHALL PROTECT AND MAINTAIN ALL EXISTING UTILITY SERVICES THROUGHOUT CONSTRUCTION. CONTACT U.F.P.O. AT 1-800-962-7962 AT LEAST 72 HOURS

3. THIS SITE DOES NOT FALL WITHIN ANY FEMA SPECIAL FLOOD HAZARD ZONES, THE SITE IS LOCATED IN ZONE X, PER C.P. #360598 0015 C MAP REVISED MARCH 3, 1997.

4. NO CHANGES ARE TO BE MADE TO THIS DESIGN WITHOUT PRIOR APPROVAL OF THE DESIGN

5. ALL IMPROVEMENTS SHALL BE IN ACCORDANCE WITH THE MOST RECENT STANDARDS AND SPECIFICATIONS OF THE TOWN OF CANANDAIGUA AND THE APPROPRIATE WATER/SEWER AGENCIES,

6. THE CONTRACTOR SHALL LOCATE, MARK, SAFEGUARD AND PRESERVE ALL SURVEY CONTROL MONUMENTS AND RIGHT-OF-WAY MONUMENTS IN THE AREAS OF CONSTRUCTION.

7. PROPOSED LIGHTING TO BE COORDINATED WITH THE ARCHITECT AND OWNER. LIGHTING SHALL BE DARK SKY COMPLIANT (PER CHAPTER 220, SECTION 77).

8. ELEVATIONS REFERENCE NAVD88 DATUM

9.THIS PROPERTY MAY BE NEAR A FARM, AS DEFINED IN THE NEW YORK STATE AGRICULTURE AND MARKETS LAW, § 301, SUBSECTION 11. SOUND FARMING PRACTICES MAY GENERATE DUST, ODOR, SMOKE, NOISE, AND VIBRATION."

ONE STAGE SITE PLAN APPROVAL

PLANNING BOARD CHAIRPERSON HIGHWAY & WATER SUPERINTENDENT

NO BUILDING PERMIT MAY BE ISSUED UNTIL FINAL SITE PLAN APPROVAL HAS BEEN GRANTED AND THE FINAL SITE PLAN SIGNED BY THE PLANNING BOARD CHAIRPERSON.

FOR PERMITTING ONLY

" Unauthorized alteration or addition to a map bearing a Licensed Professional Engineer's or Professional Land Surveyor's seal in any way is a Violation of Section 7209

" Copyright 2019" Venezia & Associates. All rights reserved unauthorized duplication is a violation of all applicable laws"




🗕 5120 Laura Lane 🗕

Iron pin or pipe found P.K. nail set X Iron pin set Concrete Monument Drill hole Benchmark Utility lines R.O.W. line

NO.	Date	Description	Ву	
1.	2/7/20	Additional Disturbance and Plantings Shown	B.G.	

Revisions



Drawing Title: SITE PLAN

HML PROPERTIES, LLC 5131 Silvernail Drive

Town of Canandaigua State of New York County of Ontario


Scale N.T.S. T.m. # 112.02-4-25.152 Date: 05/07/2019 Sheet:


File# 19030

(585)396-3267 — Fax. No. (585) 396-0131 — E-mail rocco@veneziasurvey.com

🗕 Canandaigua New York, 14424 🗖

www.veneziasurvey.com

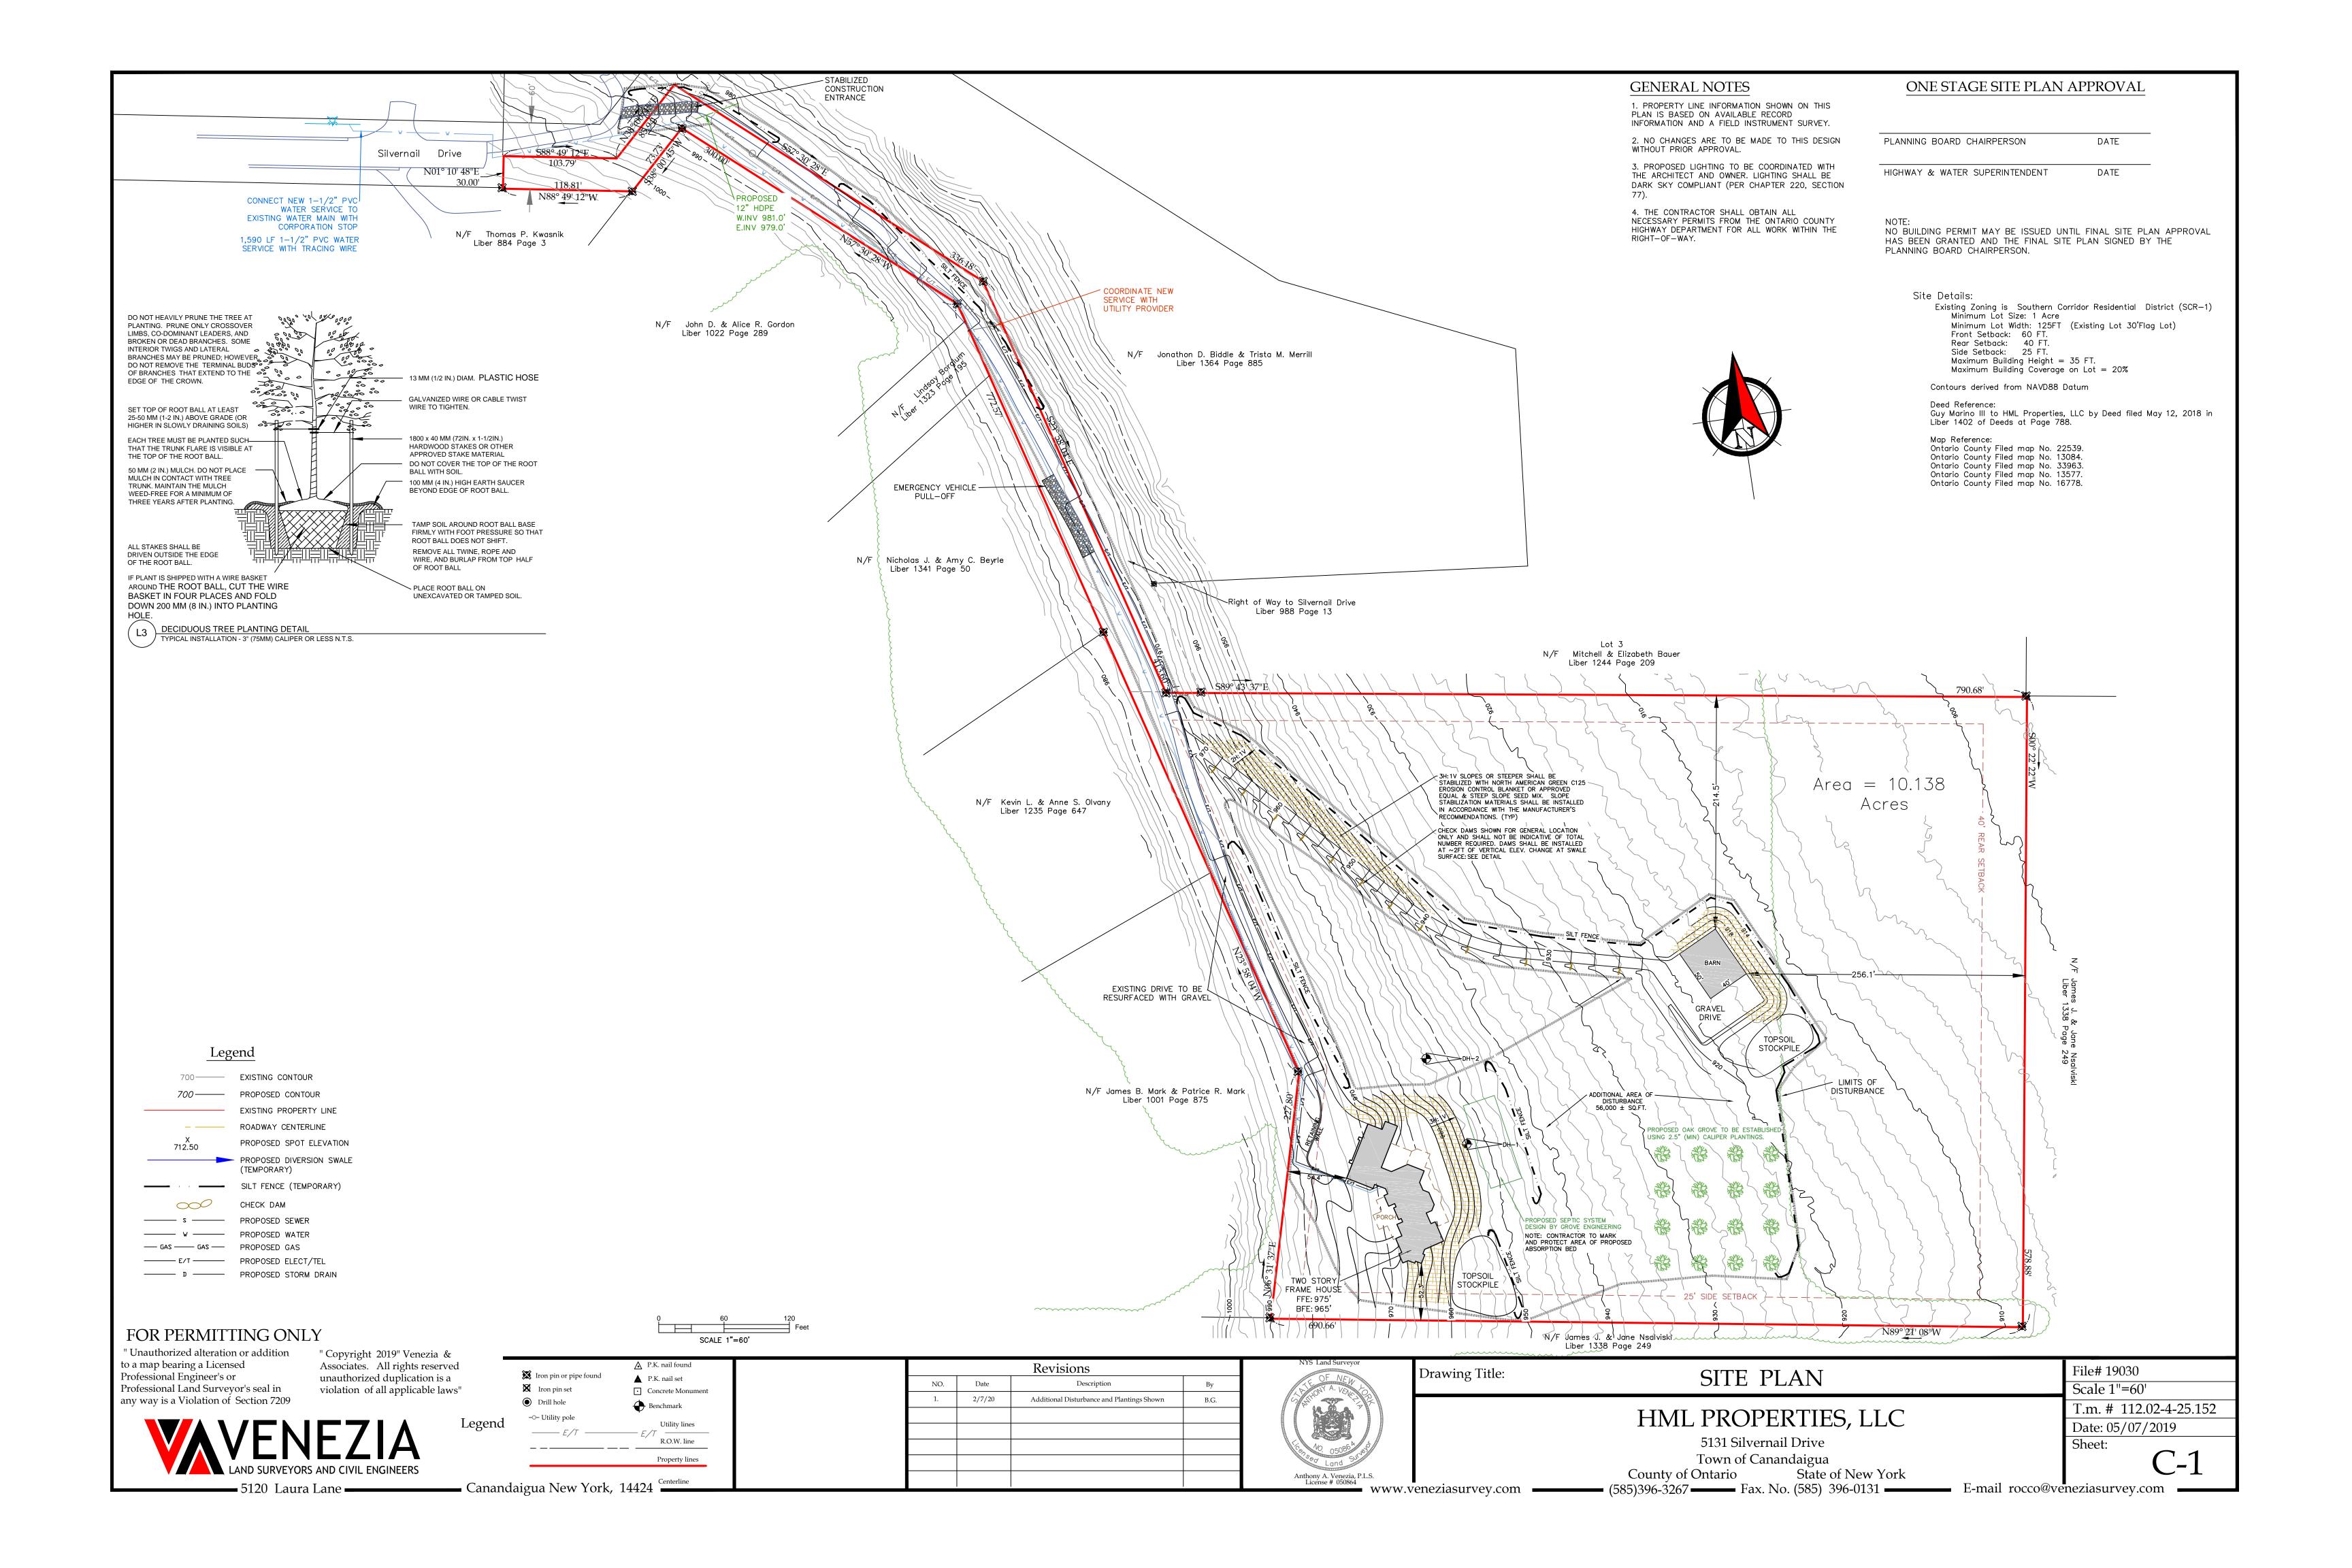

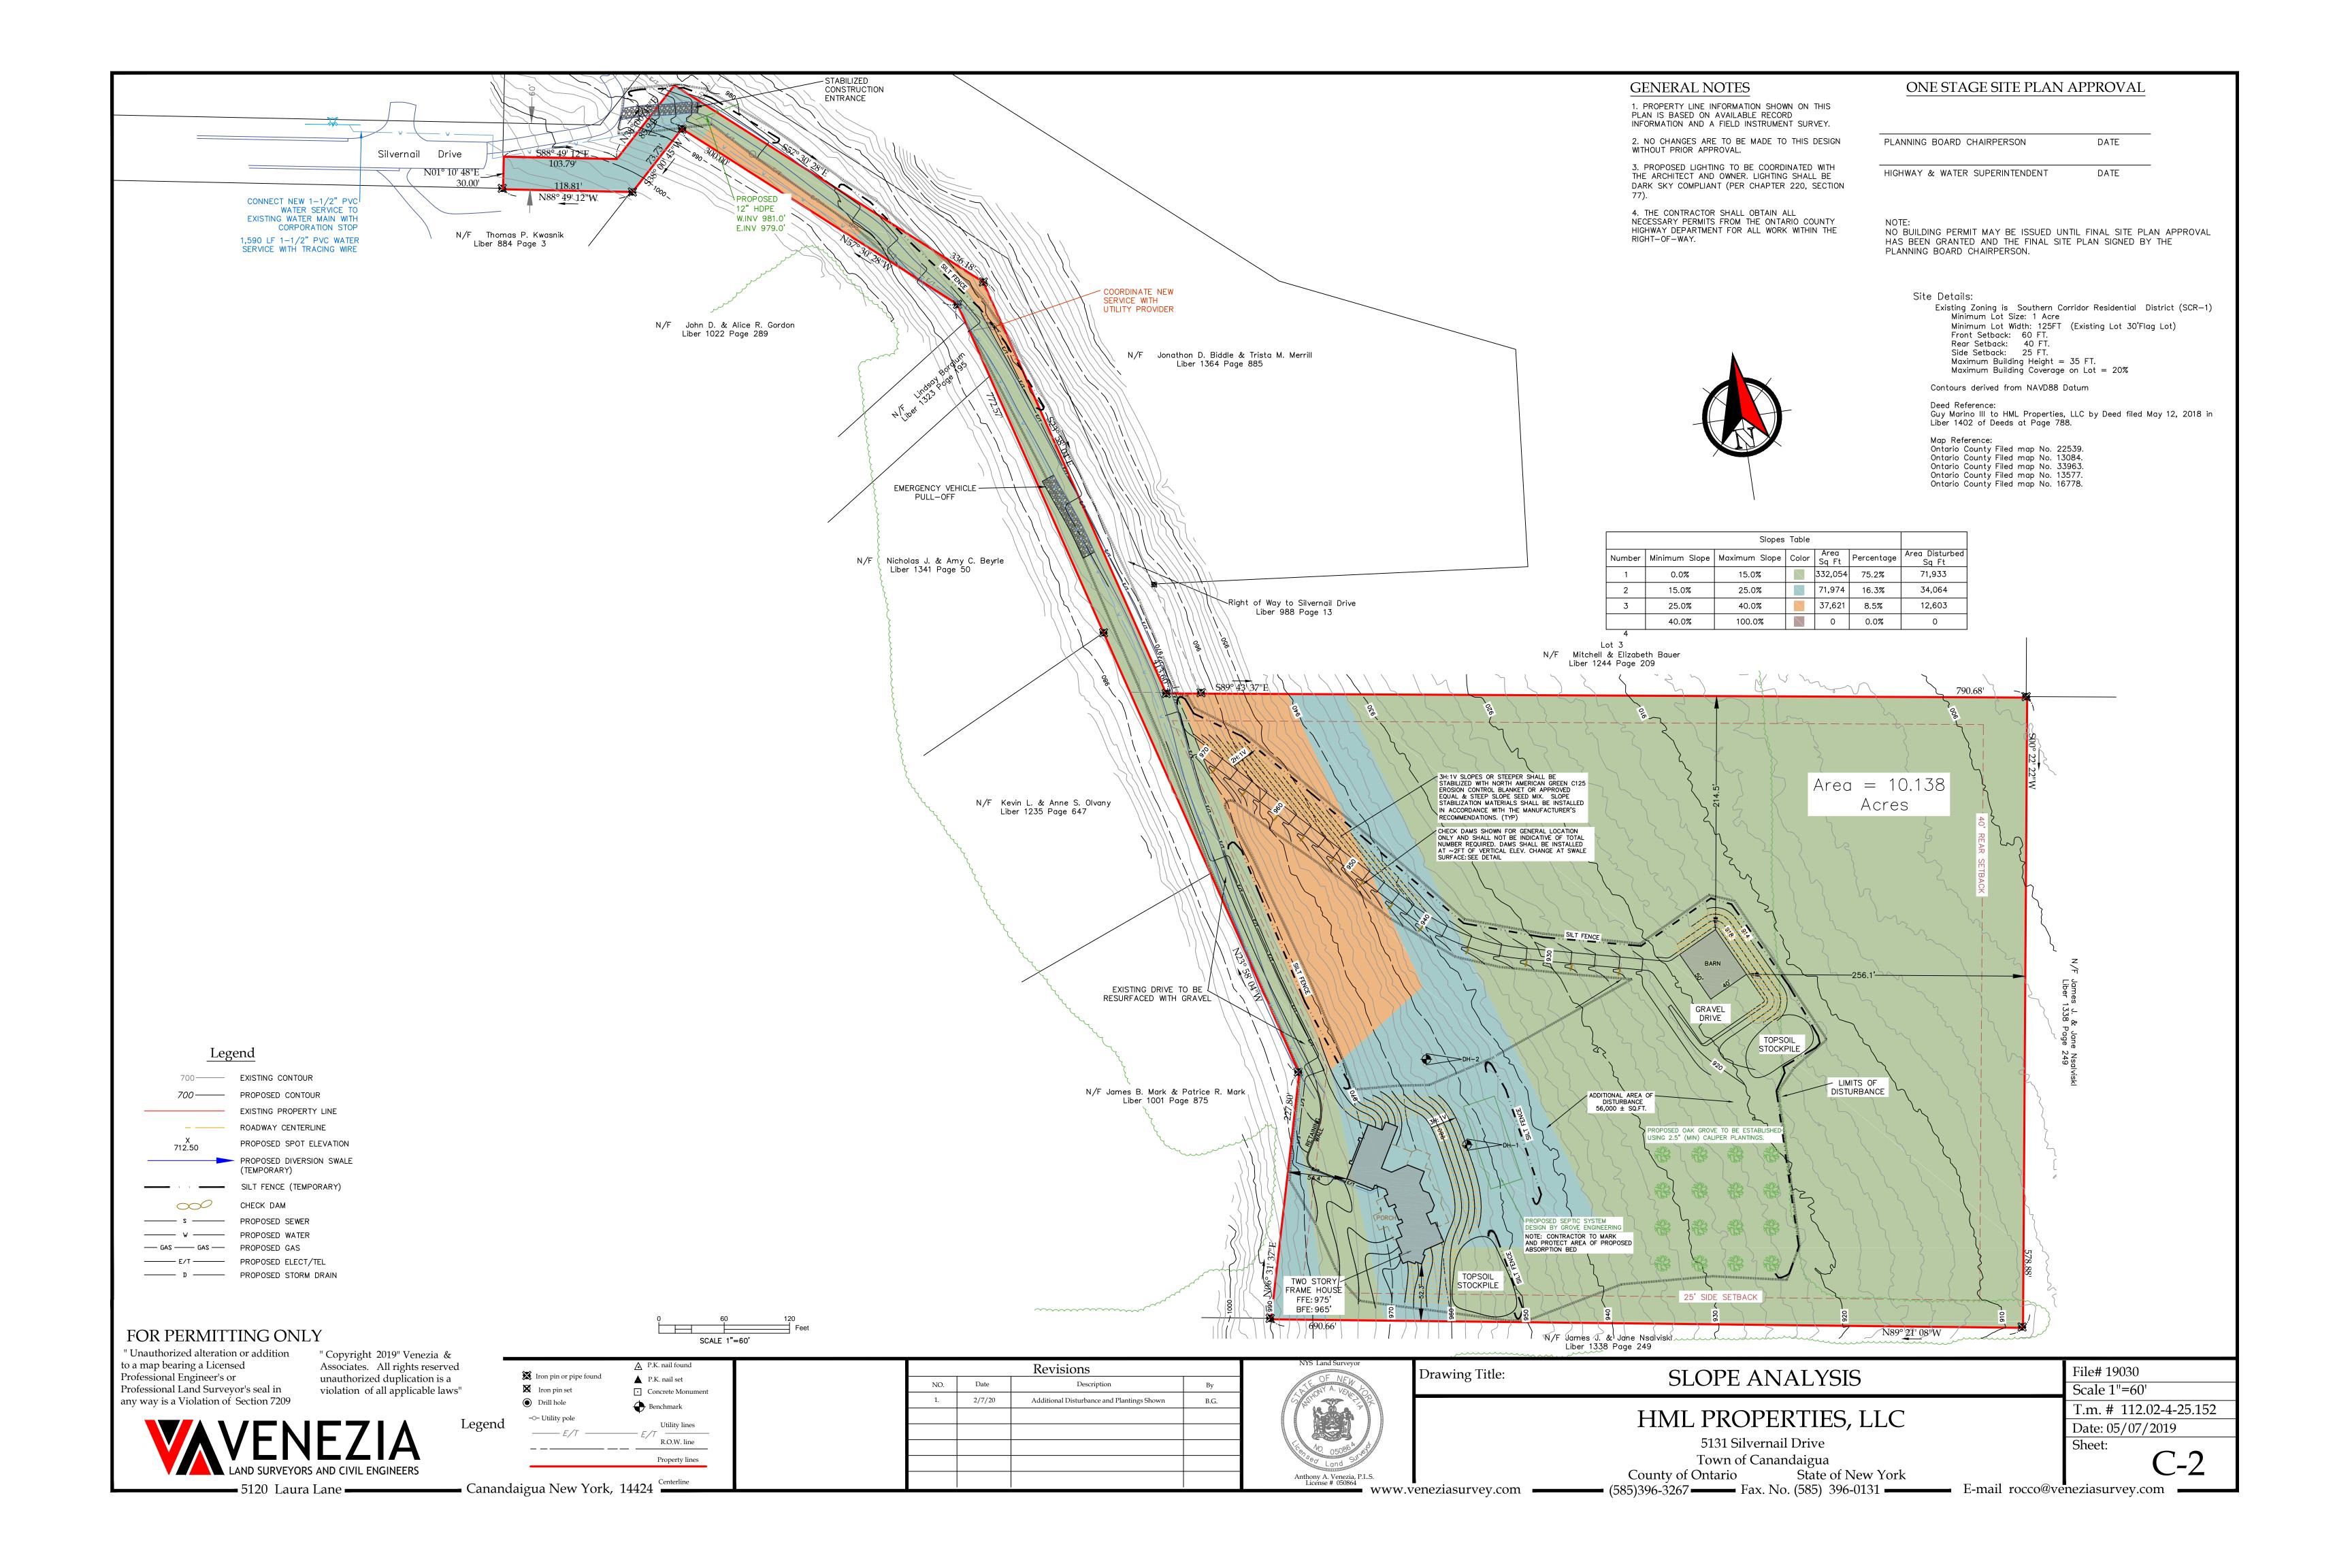

TOWN OF CANANDAIGUA STANDARD NOTES

- ALL IMPROVEMENTS SHALL BE IN ACCORDANCE WITH THE MOST RECENT STANDARDS AND SPECIFICATIONS OF THE TOWN OF CANANDAIGUA AND THE APPROPRIATE WATER/SEWER AGENCIES, UNLESS OTHERWISE NOTED.
- A STORM WATER POLLUTION PREVENTION PLAN (SWPPP) IS REQUIRED TO CONFORM WITH THE LATEST NYSDEC GENERAL PERMIT AND TO THE TOWN
- ALL SWPPP'S ARE REQUIRED TO BE REVIEWED AND APPROVED BY THE TOWN CEO AND TOWN ENGINEER. THE TOWN MS4 SWPPP ACCEPTANCE FORM IS TO
- THE OWNER IS RESPONSIBLE FOR IMPLEMENTING THE REQUIRED SWPPP. INCLUDING FILING OF THE "NOTICE OF INTENT" (NOI). A COPY OF THE NYSDEC ACKNOWLEDGEMENT LETTER IS TO BE PROVIDED TO THE TOWN DEVELOPMENT OFFICE AND TOWN ENGINEER PRIOR TO CONSTRUCTION.
- A COPY OF THE PROJECT SWPPP IS TO BE PROVIDED TO THE TOWN
- ANY MODIFICATIONS OR DEVIATIONS FROM THE APPROVED PLANS, CONSTRUCTION SEQUENCE, AND/OR SWPPP, INCLUDING IMPLEMENTATION OF
- THE OWNER IS REQUIRED TO PROVIDE DAILY ONSITE OBSERVATION BY A LICENSE PROFESSIONAL OR A CERTIFIED PROFESSIONAL IN EROSION AND SEDIMENT CONTROL (CPESC). ALL SWPPP INSPECTIONS ARE TO BE IN A FORM ACCEPTABLE BY THE TOWN OF CANANDAIGUA AND FORWARDED TO OWNER. THE TOWN CEO, TOWN ENGINEER, AND A COPY PLACED WITHIN THE ONSITE
- THE OWNER IS RESPONSIBLE FOR PROVIDING ONSITE SWPPP INSPECTIONS BY A LICENSE PROFESSIONAL OR A CERTIFIED PROFESSIONAL IN EROSION AND SEDIMENT CONTROL (CPESC) DURING CONSTRUCTION ONCE PER WEEK (EVERY 7 DAYS) IF UNDER 5-ACRES OF DISTURBANCE AND TWICE PER WEEK (EVERY 7 DAYS) IF 5-ACRES OR MORE WITH RECEIPT OF A 5-ACRE WAIVER FROM
- DEVELOPMENT IN THE CANANDAIGUA LAKE WATERSHED DISTURBING MORE THAN 5-ACRES AT ONE TIME, IS REQUIRED TO COORDINATE THE REGULAR SWPPP OBSERVATIONS REQUIRED BY THE LATEST GENERAL PERMIT WITH THE CANANDAIGUA LAKE WATERSHED INSPECTOR, THE WATERSHED PROGRAM
- DETAILED CONSTRUCTION SEQUENCE. THE CONTRACTOR SHALL COMPLETE CONSTRUCTION AND INSTALL EROSION CONTROL MEASURES IN ACCORDANCE WITH THE APPROVED CONSTRUCTION SEQUENCE UNLESS SPECIFIED OTHERWISE
- DUST SHALL BE CONTROLLED DURING CONSTRUCTION BY THE CONTRACTOR TO MINIMIZE EFFECT ON THE ADJACENT PROPERTIES. THE CONTRACTOR SHALL IMPLEMENT DUST CONTROL MEASURES AS NEEDED AND/OR AS DIRECTED BY THE TOWN OF CANANDAIGUA.
- THE OWNER'S CONTRACTOR SHALL BE RESPONSIBLE FOR THE ESTABLISHMENT, MAINTENANCE, CLEANING, REPAIR AND REPLACEMENT OF EROSION CONTROL MEASURES DURING SITE CONSTRUCTION AND UNTIL THE SITE IS FULLY STABILIZED, INSPECTED BY THE TOWN OF CANANDAIGUA, AND ISSUANCE OF THE NOTICE OF TERMINATION (NOT) HAS BEEN PROVIDED TO NYSDEC.
- ROOF LEADERS SHOULD BE CONNECTED TO STORM SEWERS WHERE POSSIBLE, UNLESS OTHERWISE SPECIFIED ON THE APPROVED PLANS AND WITHIN THE
- 14. NO SITE PREPARATION SHALL COMMENCE UNTIL A VISUAL INSPECTION BY THE TOWN OF CANANDAIGUA, CONFIRMS THE INSTALLATION OF PERIMETER SEDIMENT
- THE STORM WATER MANAGEMENT FACILITIES SHALL BE CLEANED OF
- A. ALL DISTURBED AREAS INCLUDING TOPSOIL STOCKPILES AND STORMWATER MANAGEMENT FACILITIES ARE TO BE STABILIZED WITHIN SEVEN (7) DAYS
- B. TEMPORARY SEEDING OF DISTURBED AREAS SHALL BE PROVIDED AS FOLLOWS:
- THE SURFACE TWO INCHES OF SOIL SHOULD BE LOOSENED BY DISKING, RAKING, OR BACK-BLADING WITH A BULLDOZER.
- COMPLETED AND TESTED BY HORTICULTURAL TESTING LAB AND THE SOIL TESTS SPECIFICALLY INDICATE A PHOSPHORUS DEFICIENCY THAT IS
- PLANT AND LAWN ESTABLISHMENT, PHOSPHORUS SHALL BE APPLIED AT

SPRING/SUMMER/EARLY FALL	LBS/ACRE	LBS/1,000 SQ. ACRE
ANNUAL RYE GRASS PERENNIAL RYEGRASS	30 30	0.7 0.7
LATE FALL/EARLY WINTER		
CEREAL RYE	100	2.5

MINIMAL INERT MATERIAL.

C. DISTURBED AREAS SHALL BE STABILIZED USING PERMANENT LAWN SEEDING MIX UPON COMPLETION OF GRADING AND CONSTRUCTION:

LBS/1,000 SQ. ACRE 0.20 OR 0.20 BIRDSFOOT TREFOIL OR COMMON WHITE CLOVER 8 OR 8 0.45 2 OR 5 0.05 OR 0.10 REDTOP OR RYEGRASS (PERENNIAL)

- SEEDING RATE: 6.0 POUNDS PER 1,000 SQUARE FEET
- METHOD AT TWO TONS PER ACRE WITH TACKIFIER. • FOR FALL OR EARLY WINTER, SEED WITH CERTIFIED "AROOSTOCK" WINTER
- RYE (CEREAL RYE) AT 100 POUNDS PER ACRE.
- INCLUDE JUTE MESH BLANKET AND CROWN VETCH SEED WITH PERENNIAL

- REQUIREMENTS REGARDING MAINTENANCE AND CONTROL OF STORM WATER QUALITY AND QUANTITY.
 - BE SIGNED AND INSERTED INTO THE PROJECT SWPPP PRIOR TO CONSTRUCTION. FACILITIES SUFFICIENTLY AHEAD OF CONSTRUCTION TO PERMIT REVISIONS AS REQUIRED TO MEET THE EXISTING CONDITIONS. 20. THE HOMEBUILDER WILL BE RESPONSIBLE FOR PROVIDING AND MAINTAINING INDIVIDUAL LOT EROSION & SEDIMENT CONTROL MEASURES, DURING HOUSE
- DEVELOPMENT OFFICE, TOWN ENGINEER, AND A COPY IS TO REMAIN ONSITE DURING CONSTRUCTION AT ALL TIMES IN A MARKED AND ACCESSIBLE
- EROSION CONTROL MEASURES AND STORM WATER MANAGEMENT AREAS, SHALL BE APPROVED BY THE TOWN OF CANANDAIGUA AND DOCUMENTED WITHIN THE PROJECT SWPPP.
- PROJECT SWPPP.
- THE TOWN OF CANANDAIGUA (MS4).
- MANAGER AND THE TOWN CODE ENFORCEMENT OFFICER.
- CONSTRUCTION SEQUENCE ALL PLANS ARE TO BE PROVIDED WITH A ON THE APPROVED DESIGN PLANS OR AT THE PRE -CONSTRUCTION MEETING.
- CONTROLS AND THE STABILIZED CONSTRUCTION ENTRANCE.
- UPON COMPLETION OF CONSTRUCTION AND ESTABLISHMENT OF VEGETATION,
- 16. ALL SITE STABILIZATION IS TO BE IN ACCORDANCE WITH THE LATEST VERSIONS OF THE NYSDEC STANDARDS AND SPECIFICATIONS FOR EROSION AND SEDIMENT CONTROL AND THE NYSDEC GENERAL PERMIT REQUIREMENTS (WHERE

ADDITIONAL TEMPORARY AND PERMANENT SEEDING AND SITE STABILIZATION

- REQUIREMENTS:

- FERTILIZE WITH 300 POUNDS PER ACRE (OR 7 POUNDS PER 1,000 SQUARE • NO PHOSPHORUS SHALL BE USED UNLESS SOIL TESTING HAS BEEN
- HARMFUL, OR WILL PREVENT NEW LAWNS AND PLANTINGS FROM ESTABLISHING PROPERLY. • IF SOIL TESTS INDICATE A PHOSPHORUS DEFICIENCY THAT WILL IMPACT
- THE MINIMUM RECOMMENDED LEVEL PRESCRIBED IN THE SOIL TEST FOLLOWING ALL NYSDEC REGULATIONS. • THE FOLLOWING SEED MIX SHALL BE USED:

SPRING/SUMMER/EARLY FALL	LBS/ACRE	LBS/1.000 SQ. ACRE
ANNUAL RYE GRASS PERENNIAL RYEGRASS	30 30	0.7 0.7
LATE FALL/EARLY WINTER		
CEREAL RYE	100	2.5

• SEED SHOULD HAVE A GERMINATION RATE OF AT LEAST 85 PERCENT AND

- MULCH: STRAW OR WOOD FIBER MULCH USED WITH HYRDO SEEDING
- PERMANENT STABILIZATION FOR STEEP SLOPES GREATER THAN 3:1 SHALL

FOR PERMITTING ONLY

" Unauthorized alteration or addition to a map bearing a Licensed Professional Engineer's or Professional Land Surveyor's seal in any way is a Violation of Section 7209

"Copyright 2019" Venezia & Associates. All rights reserved unauthorized duplication is a violation of all applicable laws"



• 5120 Laura Lane **=**



Iron pin or pipe found

X Iron pin set

 Concrete Monument R.O.W. line Canandaigua New York, 14424

A P.K. nail found

P.K. nail set

18. THE CONTRACTOR SHALL LOCATE, MARK, SAFEGUARD AND PRESERVE ALL

SURVEY CONTROL MONUMENTS AND RIGHT-OF-WAY MONUMENTS IN THE

19. EXISTING UNDERGROUND UTILITIES SHOWN HEREIN WERE PLOTTED FROM FIELD

LOCATIONS AND/OR UTILITY COMPANY RECORD PLANS. PRIOR TO ANY

CONSTRUCTION. MEASURES TO BE MAINTAINED UNTIL FINAL LOT LAWN

21. ANY ADDITIONAL EROSION OR SEDIMENT CONTROL MEASURES DEEMED

22. SEDIMENT CONTROL MEASURES ARE TO BE ESTABLISHED PRIOR TO

23. THE CONTRACTOR IS RESPONSIBLE FOR MAINTAINING, REPLACING AND

24. THE CONTRACTOR SHALL BE RESPONSIBLE FOR CLEANING ADJOINING

INCHES SHALL BE APPROVED BY THE PLANNING BOARD.

SITE PREPARATION & EARTHWORK SEQUENCE

STAGING AREAS AND SOIL STOCKPILE AREAS.

4. BEGIN HOUSE FRAMING.

REPRESENTATIVE.

FINISHED GRADE -

I. COPPER SERVICES SHALL BE ENCASED ALL AROUND WITH SELECT EARTH. SERVICES SHALL BE TYPE K COPPER OR 200 P.S.I. CTS PLASTIC FROM THE MAIN TO THE CURB STOP.

PLASTIC SERVICES (CTS 200) ALLOWED FROM THE CURB STOP TO THE STRUCTURE. TRACER WIRE SHOULD BE PROVIDED AS SHOWN.

3. ALL RESIDENTIAL SERVICE SHALL BE 1" MIN. DIAMETER.

4. CURB BOXES SHALL NOT BE LOCATED IN DRIVEWAY AREAS.

WATERMAIN

- DOUBLE STRAF

(MUELLER)

PROJECTED SEQUENCING LISTED ABOVE.

PLAN. INSTALL NEW UTILITY SERVICE CONNECTIONS.

3. INSTALL FOUNDATION/BASEMENT, GRADE, STABILIZE DRIVEWAY.

1. SILT FENCING, EROSION CONTROL MEASURES AND LIMITS OF WORK BOUNDARIES

2. ESTABLISH PROPOSED DRIVEWAY AREA AND HOUSE BUILDING PAD PER SITE

5. REMOVE EROSION CONTROLS AND CEASE MONITORING ONLY AFTER APPROVAL

- ACTUAL ON-SITE CONDITIONS MAY PRECIPITATE A NEED TO REVISE THE

HAS BEEN GRANTED BY THE TOWN OF CANANDAIGUA AND/OR THEIR PROJECT

EASEMENT LINE

BE ATTACHED

POSITIVE CONTACT

TYPICAL WATER SERVICE

- TEMPORARY MARKER

PER IND. CODE 53

(TOP PAINTED BLUE)

TYPE CURB BOX

10 GAUGE COPPERHEAD

(FOR ALL PLASTIC SERVICES)

TRACING WIRE

- CURB STOP (MUELLER)

2"x4"x16" CONC. BLOCK

COMPACTED SUBGRADE

ARE TO BE PLACED PER PLAN. INSTALL CONSTRUCTION ENTRANCE. ESTABLISH

COMMENCING EARTHWORK. SEDIMENT CONTROL MEASURES ARE TO BE

SUBSEQUENTLY REMOVING TEMPORARY EROSION & SEDIMENT CONTROL

25. ANY FINAL GRADE DEVIATIONS OF HOUSE PAD ELEVATIONS MORE THAN 12

CANANDAIGUA.

GRADING AND SITE IS FULLY STABILIZED AND INSPECTED BY THE TOWN OF

NECESSARY BY THE TOWN OF CANANDAIGUA OR A REPRESENTATIVE THEREOF

MAINTAINED BY THE CONTRACTOR UNTIL UPSTREAM GROUND COVER HAS BEEN

ESTABLISHED AND REMOVAL IS APPROVED BY THE TOWN OF CANANDAIGUA.

PROPERTIES, ROADWAYS, DRAINAGE WAYS AND SINKS OF SILT ACCUMULATION

AS NEEDED AND AS DETERMINED/REQUESTED BY THE TOWN OF CANANDAIGUA.

SHALL BE PROVIDED BY THE OWNER AND INSTALLED BY THE CONTRACTOR.

CONSTRUCTION, THE CONTRACTOR SHALL CALL THE DIG SAFELY NEW YORK

(UFPO) HOTLINE AT 1-800-962-7962 FOR STAKEOUT OF EXISTING UTILITIES.

THE CONTRACTOR SHALL DETERMINE EXACT LOCATION AND ELEVATION OF

UNDERGROUND UTILITIES BEFORE COMMENCING CONSTRUCTION. CONTRACTOR

SHALL MAKE EXPLORATION EXCAVATIONS TO LOCATE EXISTING UNDERGROUND

Revisions Description By NO. 2/7/20 Additional Disturbance and Plantings Shown B.G.

WATER SYSTEM NOTES

TOWN OF CANANDAIGUA AND NEW YORK STATE DEPARTMENT OF HEALTH.

SETTLING AND POSSIBLY BREAKING THE WATERMAINS.

- 50 FT. MIN. -

6" MIN. DEPTH

<u>PROFILE</u>

PLAN VIEW

- FILTER FABRIC

NOT TO SCALE

1.) STONE WILL BE PLACED ON A FILTER FABRIC FOUNDATION TO THE LINES, GRADES AND LOCATION SHOWN IN THE PLAN.

3.) EXTEND THE STONE A MINIMUM OF 1.5 FEET BEYOND THE DITCH BANKS TO PREVENT CUTTING AROUND THE DAM.

2.) SET SPACING OF CHECK DAMS TO ASSUME THAT THE ELEVATIONS OF THE CREST OF THE DOWNSTREAM DAM IS AT THE SAME ELEVATION OF THE TOE OF THE

4.) PROTECT THE CHANNEL DOWNSTREAM OF THE LOWEST CHECK DAM FROM SCOUR AND EROSION WITH STONE OR LINER AS APPROPRIATE.

5.) ENSURE THAT CHANNEL APPURTENANCES SUCH AS CULVERT ENTRANCES BELOW CHECK DAMS ARE NOT SUBJECT TO DAMAGE OR BLOCKAGE FROM DISPLACED STONES.

CHECK DAM DETAIL

CONSTRUCTION SPECIFICATIONS

WATERMAINS AND APPURTENANCES SHALL BE CONSTRUCTED IN COMPLIANCE WITH THE MOST RECENT STANDARDS AND SPECIFICATIONS OF THE

2. PROVIDE 10' MINIMUM SEPARATION BETWEEN THE WATERMAIN AND SEWER MAINS. VERTICAL SEPARATION BETWEEN WATERMAINS SHALL BE

4. THE WATERMAIN SHALL BE FLUSHED PRIOR TO TESTING AND DISINFECTION WITH A MINIMUM FLUSHING VELOCITY OF 2.5 FEET PER SECOND.

5. THE WATERMAIN, INCLUDING FITTINGS AND VALVES, SHALL COMPLY WITH AWWA C-600 SECTION 2 SPECIFICATIONS AND SHALL BE PRESSURE

6. DISINFECTION SHALL BE ACCOMPLISHED AFTER THE PIPE HAS PASSED THE HYDROSTATIC TESTS AND SHALL BE IN CONFORMANCE WITH AWWA

C-651, LATEST REVISION, BY USING THE CONTINUOUS FEED METHOD. FOLLOWING FLUSHING, SAMPLES OF THE WATER SHALL BE COLLECTED FROM

WATERMAIN SHALL NOT BE PLACED IN SERVICE UNTIL A "COMPLETED WORKS APPROVAL" CERTIFICATE HAS BEEN ISSUED BY THE NYS DEPT. OF

1. STONE SIZE - USE #2 STONE

3. WIDTH - FULL ENTRANCE WIDTH

2. THICKNESS - NOT LESS THAN 6 (SIX) INCHES.

4. USE FILTER FABRIC UNDER STONE FOR ENTRANCE STABILITY.

5. MAINTENANCE — THE CONTRACTOR SHALL MAINTAIN THE ENTRANCE IN A CONDITION WHICH WILL PREVENT TRACKING OR SEDIMENT FLOW ONTO A PUBLIC HIGHWAY.

WHEN HIGHWAY WASHING IS REQUIRED, IT SHALL BE DONE IN A MANNER THAT DIRECTS SEDIMENT RUNOFF TOWARDS EROSION CONTROL DEVICES. INSTALL ADDITIONAL EROSION CONTROLS, IF NEEDED.

PERIODIC INSPECTION AND MAINTENANCE SHALL BE PROVIDED AFTER EACH RAINSTORM.

STABILIZED CONSTRUCTION ENTRANCE DETAILS

NOT TO SCALE

THE MAIN. FIRE HYDRANTS ARE NOT ACCEPTABLE SAMPLING POINTS. WATER SAMPLE COLLECTION SHALL BE THE RESPONSIBILITY OF THE

CONTRACTOR AND ANALYSIS OF THE SAMPLES SHALL BE PERFORMED BY A NYS DEPARTMENT OF HEALTH APPROVED LABORATORY. THE

MAINTAINED IN ACCORDANCE WITH THE WATERMAIN/SEWER CROSSING DETAIL. WHERE A WATERMAIN CROSSES UNDER A SEWER, ADEQUATE

3. WATERMAIN SHALL BE PVC PIPE, AWWA C-900 AND SHALL HAVE A MINIMUM OF 5-FEET OF COVER FROM FINISHED GRADE.

AND LEAKAGE TESTED IN ACCORDANCE WITH AWWA C605 SECTION AND THE LATEST SPECIFICATIONS OF THE NYSDOH.

PAVEMENT

∠MOUNTABLE BERM

SPACING VARIES DEPENDING ON

MAXIMUM DRAINAGE AREA - 2 ACRES

NOT TO SCALE

STRUCTURAL SUPPORT (COMPACT SELECT FILL) SHALL BE PROVIDED FOR THE SEWERS TO PREVENT EXCESSIVE DEFLECTION OF JOINTS AND





Anthony A. Venezia, P.L.S. License # 050864

Drawing Title:

www.veneziasurvev.com

SITE PLAN

(5cm-12.5cm

HML PROPERTIES, LLC 5131 Silvernail Drive

Town of Canandaigua County of Ontario State of New York


– (585)396-3267 **–––** Fax. No. (585) 396-0131 **–––** E-mail rocco@veneziasurvev.com

POSTS SHALL BE 4" MIN. DIA. PINE LOCATED DOWNSLOPE OF FABRIC TO HELP SUPPORT FENCE. FILTER FENCE FABRIC SHALL BE OF NYLON, POLYESTER, PROPYLENE, OR ETHYLENE YARN WITH EXTRA STRENGTH 50LB/LIN, IN,(MIN), WITH A FLOW SLOPE RATE OF AT LEAST 0.3 GAL./SQFT/MINUTE. FABRIC SHOULD CONTAIN UV RAY INHIBITORS AND STABILIZERS. COMPACTED FILL OVER TOE OF FABRIC BURIED 8" DEEP. FABRIC OR EQUAL (STAPLE TO LATHE)

> SILT FENCE DETAIL NOT TO SCALE

BURY END

OF FABRIC

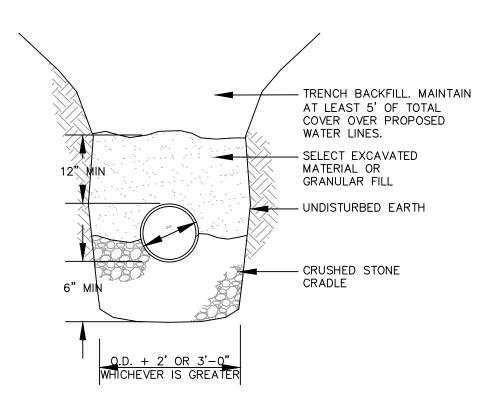

PVC WATER MAIN & DRAIN BEDDING DETAIL NOT TO SCALE

SLOPE INSTALLATION **AMERICAN** GREEN ROSION CONTROL Products Guaranteed SOLUTIONS 14649 HIGHWAY 41 NORTH EVANSVILLE, IN 47725 800-772-2040 www.nagreen.com OF LIME, FERTILIZER, AND SEED.

- . PREPARE SOIL BEFORE INSTALLING ROLLED EROSION CONTROL PRODUCTS (RECP's), INCLUDING ANY NECESSARY APPLICATION NOTE: WHEN USING CELL-O-SEED DO NOT SEED PREPARED AREA. CELL-O-SEED MUST BE INSTALLED WITH PAPER SIDE DOWN.
- BEGIN AT THE TOP OF THE SLOPE BY ANCHORING THE RECP'S IN A 6" (15 CM) DEEP X 6" (15 CM) WIDE TRENCH BEGIN AT THE TOP OF THE SLOPE BY ANCHORING THE RECP'S IN A 6 (15 CM) DEEP X 6 (15 CM) WIDE TRENCH WITH APPROXIMATELY 12" (30cm) OF RECP'S EXTENDED BEYOND THE UP—SLOPE PORTION OF THE TRENCH. ANCHOR THE RECP'S WITH A ROW OF STAPLES/STAKES APPROXIMATELY 12" (30 CM) APART IN THE BOTTOM OF THE TRENCH. BACKFILL AND COMPACT THE TRENCH AFTER STAPLING. APPLY SEED TO COMPACTED SOIL AND FOLD REMAINING 12" (30 CM) PORTION OF RECP'S BACK OVER SEED AND COMPACTED SOIL. SECURE RECP'S OVER COMPACTED SOIL WITH A ROW OF STAPLES/STAKES SPACED APPROXIMATELY 12" (30 CM) APART ACROSS THE WIDTH OF THE RECP's.
- . ROLL THE RECP's (A.) DOWN OR (B.) HORIZONTALLY ACROSS THE SLOPE. RECP'S WILL UNROLL WITH APPROPRIATE SIDE AGAINST THE SOIL SURFACE. ALL RECP'S MUST BE SECURELY FASTENED TO SOIL SURFACE BY PLACING STAPLES/STAKES IN APPROPRIATE LOCATIONS AS SHOWN IN THE STAPLE PATTERN GUIDE. WHEN USING THE DOT SYSTEM™, STAPLES/STAKES SHOULD BE PLACED THROUGH EACH OF THE COLORED DOTS CORRESPONDING TO THE APPROPRIATE STAPLE PATTERN. . THE EDGES OF PARALLEL RECP'S MUST BE STAPLED WITH APPROXIMATELY 2" - 5" (5 CM - 12.5 CM) OVERLAP DEPENDING
- 5. CONSECUTIVE RECP'S SPLICED DOWN THE SLOPE MUST BE PLACED END OVER END (SHINGLE STYLE) WITH AN APPROXIMATE 3" (7.5 CM) OVERLAP. STAPLE THROUGH OVERLAPPED AREA, APPROXIMATELY 12" (30 CM) APART ACROSS ENTIRE
- *IN LOOSE SOIL CONDITIONS, THE USE OF STAPLE OR STAKE LENGTHS GREATER THAN 6" (15 CM) MAY BE NECESSARY TO PROPERLY SECURE THE RECP's.

ONE STAGE SITE PLAN APPROVAL

DATE

DATE

T.m. # 112.02-4-25.152

File# 19030

Scale: NTS

Sheet:

Date: 05/07/2019

PLANNING BOARD CHAIRPERSON HIGHWAY & WATER SUPERINTENDENT