

CONSTRUCTION SEQUENCE NOTES

CONSTRUCTION SEQUENCE

THE CONSTRUCTION SEQUENCE SCHEDULE CONSISTS OF 8 GENERAL STEPS. THE CONTRACTOR IS TO FOLLOW THE SEQUENCE AS DESCRIBED IN THIS REPORT AND AS SUPPLEMENTED ON THE PLAN SET. THE CONSTRUCTION SEQUENCE IS AS FOLLOWS:

STEP 1: PRE-CONSTRUCTION ACTIONS

- RESOURCE PROTECTION
 - EVALUATE, MARK AND PROTECT IMPORTANT TREES AND ASSOCIATED ROOTING ZONES, WETLANDS, ON-SITE SEPTIC SYSTEMS ABSORPTION FIELDS, ETC.
- SURFACE WATER PROTECTION
 - PROTECT ON-SITE OR DOWNSTREAM SURFACE WATER SUBJECT TO DISTURBED AREA RUNOFF AS SHOWN ON DRAWINGS.
- STABILIZE CONSTRUCTION ENTRANCE
 - ESTABLISH TEMPORARY CONSTRUCTION ENTRANCE.
 - STABILIZE BARE AREAS (ENTRANCES, CONSTRUCTION ROUTES AND EQUIPMENT PARKING AREAS) IMMEDIATELY AS WORK TAKES PLACE. THE CONTRACTOR SHALL TOP THESE AREAS WITH GRAVEL OR MAINTAIN VEGETATIVE COVER.
 - REMOVE SEDIMENT TRACKED ONTO PUBLIC STREETS TO THE SATISFACTION OF THE INSPECTING ENGINEER OR GOVERNING MUNICIPALITY. CONTINUE TO REMOVE ANY SEDIMENT TRACKED THROUGHOUT THE FOLLOWING STEPS OR UNTIL SITE STABILIZATION IS ESTABLISHED.
- PERIMETER SEDIMENT CONTROLS
 - INSTALL SILT FENCE AS SHOWN ON DRAWINGS, OR AS DIRECTED BY INSPECTING ENGINEER OR GOVERNING MUNICIPALITY. PLACE SILT FENCE ON OR PARALLEL TO CONTOURS WHERE THERE IS NO CONCENTRATED WATER FLOWING.
 - INSTALL PRINCIPAL SEDIMENT BASINS AS SHOWN ON THE DRAWINGS OR AS DIRECTED BY INSPECTING ENGINEER OR GOVERNING MUNICIPALITY.
 - INSTALL ADDITIONAL SEDIMENT TRAPS AND BARRIERS MAY BE REQUIRED DURING THE COURSE OF CONSTRUCTION.

STEP 2: RUNOFF AND DRAINAGE CONTROL

- RUNOFF CONTROL
 - INSTALL REMAINING EROSION CONTROL FEATURES.
 - DIVERT OFFSITE OR CLEAN RUNOFF AWAY FROM OR AROUND DISTURBED AREAS.
 - CONVEY SURFACE FLOWS FROM HIGHLY ERODIBLE SOIL AND STEEP SLOPES TO MORE SUITABLE STABLE AREAS.
 - SLOW OR REDIRECT RUNOFF FROM EXISTING OR PROPOSED CUT AND FILL SLOPES TO LOWER WATER VELOCITY.
 - ENSURE SITE DRAINAGE PREVENTS EROSION, CONCENTRATED FLOWS TO ADJACENT PROPERTIES, UNCONTROLLED OVERFLOW, AND PONDING.
- RUNOFF CONVEYANCE SYSTEM
 - INSTALL CHECK DAMS TO SLOW DOWN THE VELOCITY OF CONCENTRATED FLOWS AS SHOWN ON THE DRAWINGS.
 - STABILIZE THE CONVEYANCE SYSTEM.
 - SEED CHANNELS AND STREAM BANKS AT THE POND OUTLET POINTS.
 - PROTECT EXISTING NATURAL DRAINAGE SYSTEMS AND STREAMS BY MAINTAINING VEGETATIVE BUFFERS AND BY IMPLEMENTING OTHER APPROPRIATE EROSION CONTROL PRACTICES.

STEP 3: GRADING

- LIMIT INITIAL CLEARING AND EARTH DISTURBANCE TO THAT NECESSARY TO INSTALL SEDIMENT CONTROL MEASURES. EXCAVATION FOR FOOTINGS, CLEARING OR OTHER EARTH DISTURBANCE MAY ONLY TAKE PLACE AFTER THE SEDIMENT AND EROSION CONTROLS ARE INSTALLED.
- STOCKPILE REMOVED TOPSOIL. PROTECT, STABILIZE AND LOCATE PILE AWAY FROM STORM WATER FACILITIES.
- MAINTAIN AND DO NOT DISTURB ESTABLISHED BUFFERS, THE HIGH WATER LINE OF A WATER BODY, STEEP SLOPES OR OTHER PROTECTED ZONES.
- DO NOT IMPAIR EXISTING SURFACE DRAINAGE THAT WILL RESULT IN A POTENTIAL EROSION HAZARD IMPACTING ADJACENT LAND OR WATER BODIES.
- NOTIFY GOVERNING MUNICIPALITY AND INSPECTING ENGINEER SHOULD THEY ENCOUNTER FARM TILES DURING EARTH MOVING OPERATIONS TO DETERMINE REMOVAL, PLUG, OR CONNECTION TO STORM SEWER.

STEP 4: EROSION CONTROL MAINTENANCE AND STABILIZATION

- MAINTAIN EROSION CONTROL FEATURES IN GOOD WORKING ORDER.
- IMMEDIATELY STABILIZE SITE PERIMETER SURFACES.
- STABILIZE SOIL STOCKPILES AND EXPOSED SURFACES BY SEED, MULCH, OR OTHER APPROPRIATE MEASURES AS SOON AS POSSIBLE BUT NO LATER THAN 14 DAYS AFTER CONSTRUCTION ACTIVITY HAS CEASED IN THAT AREA.
- APPLY TEMPORARY OR PERMANENT STABILIZATION MEASURES IMMEDIATELY ON ALL DISTURBED AREAS WHERE WORK IS DELAYED OR COMPLETED.
-

INSTALL ADDITIONAL MEASURES IF ORDERED BY THE INSPECTING ENGINEER OR THE GOVERNING MUNICIPALITY

STEP 5: SEDIMENT CONTROL

- SWALES OR OTHER AREAS THAT TRANSPORT CONCENTRATED FLOW SHOULD BE APPROPRIATELY STABILIZED.
- DOWNSPOUT OR PUMP PUMP DISCHARGES MUST HAVE ACCEPTABLE OUTFALLS THAT ARE PROTECTED BY SPLASH BLOCKS, SOD, OR PIPING AS REQUIRED BY SITE CONDITIONS (I.E., NO CONCENTRATED FLOW DIRECTED OVER FILL SLOPES) OR AS DIRECTED BY THE INSPECTING ENGINEER OR THE GOVERNING MUNICIPALITY.

STEP 6: MAINTENANCE AND INSPECTION

- INSPECT FEATURES AS INDICATED ON THE DRAWINGS. AT A MINIMUM, DEVELOPER WILL PERFORM INSPECTIONS ONCE EVERY 7 CALENDAR DAYS OR TWICE EVERY 7 DAYS SHOULD DISTURBED AREA MEET OR EXCEED 5 ACRES, AND WITHIN 24 HOURS AFTER PERIODS OF RAINFALL GREATER THAN 0.5 INCH.
- MAINTAIN, REPAIR AND/OR ADD EROSION AND SEDIMENT CONTROL FEATURES AS DIRECTED BY INSPECTING ENGINEER OR THE GOVERNING MUNICIPALITY.
- LOOK FOR EVIDENCE OF SOIL EROSION AND/OR POLLUTANTS ENTERING DRAINAGE SYSTEMS, PROBLEMS AT DISCHARGE POINTS (SUCH AS TURBIDITY IN RECEIVING WATER), AND SIGNS OF SOIL AND MUD TRANSPORT FROM THE SITE TO THE PUBLIC ROAD AT THE ENTRANCE.
- ROUTINE MAINTENANCE MUST BE IDENTIFIED ON THE SCHEDULE AND PERFORMED ON A REGULAR BASIS AND AS SOON AS A PROBLEM IS IDENTIFIED.
- PROVIDE AND IDENTIFY THE PERSON OR ENTITIES RESPONSIBLE FOR CONDUCTING THE MAINTENANCE ACTIONS DURING CONSTRUCTION AND POST-CONSTRUCTION.
- RETAIN A COPY OF THE INSPECTION AND QUARTERLY REPORTS ON-SITE WITH THE SWPPP DURING CONSTRUCTION PHASES IN AN ACCESSIBLE BUT SAFEGUARDED LOCATION.

STEP 7: FINALIZE GRADING & LANDSCAPING

- RESTORE ALL DISTURBED PVIOUS AREAS IN COMPLIANCE WITH NYSDEC STORMWATER MANAGEMENT DESIGN MANUAL TABLE 5.3.
- STABILIZE ALL OPEN AREAS, INCLUDING BORROW AND SPOIL AREAS USING PERMANENT TOPSOIL, SEED, SOD, MULCH, RIP RAP OR OTHER PRACTICE AS SHOWN ON THE DRAWINGS.
- STABILIZATION MUST BE UNDERTAKEN NO LATER THAN 14 DAYS AFTER CONSTRUCTION ACTIVITY HAS CEASED OR AS NOTED IN THE SWPPP.
- REMOVE THE TEMPORARY CONTROL MEASURES WITHIN 7 DAYS AFTER DIRECTED BY INSPECTING ENGINEER OR GOVERNING MUNICIPALITY.

STEP 8: POST CONSTRUCTION CONTROLS

- IDENTIFY THE PERMANENT STRUCTURAL OR NON-STRUCTURAL PRACTICES THAT WILL REMAIN ON THE SITE.
- DEVELOPER SHALL ENSURE THAT THE PERMANENT STRUCTURAL OR NON-STRUCTURAL PRACTICES UTILIZED DURING CONSTRUCTION ARE PROPERLY DESIGNED TO SUIT THE POST-CONSTRUCTION SITE CONDITIONS.

ADDITIONAL CONSTRUCTION SEQUENCE NOTES

- TEMPORARY SANITARY LATERAL CONNECTION: EARLY IN STAGE 1 OF CONSTRUCTION, THE SANITARY SEWER LATERAL WILL TEMPORARILY CONNECT TO THE EXISTING 'STELLAS' BUILDING DESIGNATED TO REMAIN OPEN AND IN WORKING CONDITION AS SHOWN ON THE UTILITY PLAN (U-1). FOLLOWING CONNECTION TO THE SANITARY SEWER, THE EXISTING SEPTIC SYSTEM WILL BE DISCONNECTED AND DISMANTLED AS DESCRIBED ON THE PLANS. INSTALLATION OF THE SANITARY LATERAL IN THE STAGE 2 CONSTRUCTION AREA WILL INVOLVE SAWCUTTING PAVEMENT EXCAVATION, BACKFILL AND COMPACTION WITHIN THE PARKING AREA DESIGNATED TO REMAIN. THE CONTRACTOR IS RESPONSIBLE FOR RESTORATION OF PAVEMENT IN AREAS DISTURBED BY TRENCHING ACTIVITIES.
- NEW WATER SERVICE STAGING: THE NEW WATER SERVICE, METERING, BACK FLOW PREVENTION DEVICES, AND ASSOCIATED FEATURES WILL BE INSTALLED AS SHOWN ON THE UTILITY PLAN, U-1 DURING STAGE 1. THE CONTRACTOR IS RESPONSIBLE FOR RESTORATION OF PAVEMENT AND OTHER FEATURES DISTURBED THAT ARE DESIGNATED TO REMAIN IN SERVICE DURING STAGE 1.
- STORM DRAINAGE SYSTEM STAGING: PORTIONS OF THE PROPOSED STORM DRAINAGE SYSTEM LOCATED IN THE STAGE 2 AREA OF CONSTRUCTION WILL BE INSTALLED DURING STAGE 2.

- MOBILE ROAD WILL BE CONSTRUCTED DURING STAGE 1 AND SUCH A MANNER THAT A MINIMUM OF ONE LANE OF TRAVEL IS TO BE MAINTAINED AT ALL TIMES TO NYS RT. 332. A DETOUR THROUGH COMPLETED STAGE 1 PARKING AND ACCESS AISLE AREAS WILL BE CONSIDERED UPON REVIEW AND APPROVAL OF THE TOWN ENGINEER AND HIGHWAY SUPERINTENDENT.
- THE EXISTING CENTER ENTRANCE ALONG NYS RT. 332 WILL BE REMOVED UPON COMPLETION OF BOTH STAGE 1 & 2 OF CONSTRUCTION. DISTURBED AREAS WILL BE RESTORED WITH TOPSOIL AND SEED IN A MANNER APPROVED BY THE NYSDOT.
- STORMWATER MANAGEMENT FACILITIES LOCATED IN THE STAGE 2 AREA OF CONSTRUCTION INCLUDING SM (BIO-RETENTION) POND 'B', OUTLET STRUCTURE AND PIPING, FILTER MATERIAL AND UNDERDRAIN, STONE WEIR, ROLLED EC FABRIC, SEEDING AND ASSOCIATED FEATURES WILL BE CONSTRUCTED DURING STAGE 2.
- EROSION CONTROL MEASURES AS DESCRIBED IN THE CONSTRUCTION SEQUENCE NOTES AND AS SHOWN ON THE GRADING AND EROSION CONTROL PLAN WILL BE CONSTRUCTED IN THE STAGE IN WHICH THEY ARE SHOWN UNLESS OTHERWISE NOTED.

GENERAL NOTES

- ALL CONSTRUCTION SHALL CONFORM TO THE REQUIREMENTS OF THE TOWN OF CANANDAIGUA AND THE COUNTY OF ONTARIO STANDARDS UNLESS MORE STRINGENT CRITERIA IS SPECIFIED ON THE CONSTRUCTION DRAWINGS.
- SANITARY SEWERS, LATERALS, AND APPURTENANCES SHALL BE CONSTRUCTED IN CONFORMANCE WITH THE REQUIREMENTS OF THE TOWN OF FARMINGTON SEWER AND WATER DEPT.
- WATER SERVICES AND APPURTENANCES SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE REGULATIONS AND SPECIFICATIONS OF THE TOWN OF FARMINGTON SEWER AND WATER DEPT
- THE LOCATIONS OF EXISTING UNDERGROUND UTILITIES SHOWN ARE APPROXIMATE AND HAVE NOT BEEN INDEPENDANTLY VERIFIED BY THE OWNER OR IT'S REPRESENTATIVE. THE CONTRACTOR SHALL DETERMINE THE EXACT LOCATION OF ALL EXISTING UTILITIES BEFORE COMMENCING WORK AND AGREES TO BE FULLY RESPONSIBLE FOR ANY AND ALL DAMAGES TO EXISTING UTILITIES THAT OCCUR DURING THE COURSE OF CONSTRUCTION.
- THE CONTRACTOR SHALL DETERMINE THE EXACT LOCATION AND ELEVATION OF UNDERGROUND UTILITIES BEFORE COMMENCING CONSTRUCTION. THE CONTRACTOR SHALL MAKE EXPLORATORY EXCAVATIONS SUFFICIENTLY AHEAD OF CONSTRUCTION TO PERMIT REVISIONS AS MAY BE REQUIRED TO MEET EXISTING CONDITIONS. THE CONTRACTOR SHALL TAKE PRECAUTIONARY MEASURES TO PROTECT THE UTILITY LINES SHOWN ON THESE PLANS AND ANY OTHER LINES NOT SHOWN.
- LOCATION OF PROPOSED IMPROVEMENTS, DISTANCE BETWEEN FACILITIES AND APPURTENANCES SHOWN ON DRAWINGS, ARE APPROXIMATE. THE CONTRACTOR SHALL DETERMINE THE EXACT LOCATION DURING THE CONSTRUCTION STAKE OUT. THE CONTRACTOR SHALL LOCATE, FLAG, AND PRESERVE PROPERTY MARKERS, U.S.G.S., AND ALL OTHER MONUMENTS.
- EROSION CONTROL DEVICES SHALL BE ESTABLISHED PRIOR TO COMMENCING EARTHWORK. EROSION CONTROL DEVICES SHALL BE MAINTAINED BY THE CONTRACTOR UNTIL UPSTREAM GROUND COVER HAS BEEN SUFFICIENTLY ESTABLISHED AND REMOVAL IS APPROVED BY THE OWNER. THE CONTRACTOR SHALL PROVIDE JUTE MESH OR ENGINEER APPROVED EROSION CONTROL FABRIC ON ALL SLOPES STEEPER THAN 4 ON 1. THE CONTRACTOR SHALL MAINTAIN SUCH DEVICES UNTIL VEGETATION IS FULLY ESTABLISHED AND APPROVED BY THE LANDSCAPE ARCHITECT. THE CONTRACTOR SHALL REMOVE EROSION CONTROL DEVICES UPON ACCEPTANCE OF VEGETATIVE COVER AND AS DIRECTED BY THE ENGINEER.
- THE APPROPRIATE CITY PERMITS WILL BE OBTAINED BEFORE CONSTRUCTION COMMENCES.
- THE CONTRACTOR SHALL MAINTAIN IN SERVICE ALL EXISTING SEWERS, CULVERTS, DITCHES, MANHOLES, AND CATCH BASINS DURING CONSTRUCTION. ANY CHANGES TO THESE EXISTING FACILITIES SHALL BE DONE BY THE CONTRACTOR AT HIS EXPENSE.
- THE CONTRACTOR IS TO VERIFY ALL EXISTING INVERT ELEVATIONS OF SEWERS PRIOR TO CONSTRUCTION OF NEW SEWERS. IF ANY INVERT ELEVATION IS FOUND TO DIFFER FROM THAT SHOWN ON THE PLANS THE CONTRACTOR SHALL NOTIFY THE ENGINEER IMMEDIATELY.
- ALL AREAS DISTURBED BY THE CONTRACTOR'S OPERATIONS SHALL BE FINISH GRADED AND SEEDDED AS PER PLANS AND SPECIFICATIONS.
- TRENCHES AND EXCAVATION IN GREEN AREAS SHALL BE SURFACED WITH 4" OF TOPSOIL TO A TOLERANCE OF 0.10' FROM THE ELEVATION GIVEN (FINISHED CONTOURS) SHAPED TO ALLOW SURFACE DRAINAGE.
- TOPSOIL IN ALL AREAS IN CUT OR FILL SHALL BE STRIPPED, STOCKPILED, AND EVENLY REDISTRIBUTED.
- MINIMUM SEPARATION BETWEEN WATERMAIN AND SEWER MAINS TO BE 18" VERTICALLY MEASURED FROM THE OUTSIDE OF THE PIPES AT THE POINT OF CROSSING. MINIMUM HORIZONTAL SEPARATION BETWEEN WATER MAINS AND SEWER MAINS TO BE 10' (FEET) MEASURED FROM THE OUTSIDE OF THE PIPES. IF A CROSSING SHOULD OCCUR, ONE FULL LENGTH OF THE SEWER SHALL BE CENTERED OVER OR UNDER THE WATER MAIN SO THAT BOTH THE JOINTS WILL BE AS FAR FROM THE SEWER AS POSSIBLE. WHERE A WATER MAIN CROSSES UNDER A SEWER, ADEQUATE STRUCTURAL SUPPORT (COMPACTED SELECT FILL) SHALL BE PROVIDED FOR THE SEWER TO PREVENT SETTLING.

15. FLOOR DRAINS, IF CONNECTED, SHALL BE CONNECTED TO THE SANITARY SEWER. FLOOR DRAINS DO NOT INCLUDE FOUNDATION/ FOOTER DRAINS. NOTE: ALL DISCHARGES TO THE SANITARY SEWER SHALL COMPLY WITH THE EFFLUENT LIMITS OF THE LOCAL SEWER USE LAW.

16. ALL WATER MAINS AND SERVICES SHALL HAVE A MINIMUM OF 5 FEET OF COVER FROM THE TOP OF THE MAIN TO FINISHED GRADE. THE CONTRACTOR SHALL CHECK ALL CUT STAKES BEFORE TRENCHING TO INSURE THAT ALL INSTALLED WATER MAINS WILL HAVE THE REQUIRED COVER.

17. THE CONTRACTOR SHALL CONTACT THE LOCAL UTILITY FOR SPECIFIC INSTRUCTIONS WITH REFERENCE TO THE SERVICE REQUIREMENTS. THE CONTRACTOR SHALL INCLUDE IN HIS BASE BID ALL COSTS CHARGEABLE TO TO THE OWNER BY THE UTILITY FOR THE INSTALLATION OF THEIR PHASE OF THE SERVICE. ALL UTILITIES SHALL BE UNDERGROUND. THE CONTRACTOR SHALL PROVIDE ALL CONDUITS AND CONDUCTORS AS REQUIRED BY THE UTILITY FOR THE INSTALLATION OF SERVICE. THE CONTRACTOR SHALL MEET ALL REQUIREMENTS IMPOSED BY THE UTILITY AND SHALL INCLUDE THIS WORK IN THE BASE BID.

18. WHERE LAWNS ARE TO BE PLANTED IN AREAS THAT HAVE NOT BEEN ALTERED OR DISTURBED BY EXCAVATING OR STRIPPING OPERATIONS, PREPARE SOIL FOR LAWN PLANTING AS FOLLOWS:

- TILL TO A DEPTH OF SIX INCHES
- APPLY SOIL AMENDMENTS AND INITIAL FERTILIZERS AS SPECIFIED
- REMOVE HIGH AREAS AND FILL IN DEPRESSIONS
- TILL SOIL TO A HOMOGENEOUS MIXTURE OF FINE TEXTURE- (FREE OF LUMPS, CLODS, STONES, ROOTS AND OTHER EXTRANEIOUS MATTER LARGER THAN 2" IN ANY DIMENSION)
- THE CONTRACTOR IS REQUIRED TO MOW AND / CLEAR ALL AREAS TO BE DISTURBED BY GRADING WORK TO A HEIGHT NO MORE THAN 6" PRIOR TO BEGINNING GRADING WORK.

19. AN ADMINISTRATIVE LOT LINE ADJUSTMENT PLAN REGARDING THE COMBINING OF LOT 1 AND LOT 2 FOR THE PROPOSED SITE IMPROVEMENTS AND FUTURE SITE IMPROVEMENTS IS REQUIRED. THE LOT LINE ADJUSTMENT PLAN WILL BE SUBMITTED TO THE DEVELOPMENT OFFICE FOR REVIEW AND APPROVAL.

EROSION CONTROL NOTES

- THE STORMWATER POLLUTION PREVENTION PLAN (SWPPP) CONSISTS OF THE STORMWATER MANAGEMENT REPORT, THE PROJECT PLANS, INCLUDING THE GRADING, CONSTRUCTION EROSION CONTROL PLAN AND DETAIL SHEET, AND THE TOWN OF CANANDAIGUA DESIGN AND CONSTRUCTION SPECIFICATIONS REGARDING STORMWATER CONTROL. THE SWPPP FOR THIS PROJECT IS INTENDED TO CONFORM WITH NYSDEC GENERAL PERMIT GP-02-01 AND THE REQUIREMENTS OF LOCAL AND NYSDEC AUTHORITIES REGARDING THE CONTROL OF STORMWATER QUANTITY AND QUALITY.
- THE OWNER IS RESPONSIBLE FOR IMPLEMENTING THE REQUIRED SWPPP. THE OWNER'S CONTRACTOR, SUB-CONTRACTOR AND ALL OTHERS ASSOCIATED WITH THE IMPLEMENTATION OF THE PLAN SHALL BE FAMILAR WITH THE PLAN AND THE CONDITIONS OF THE NYSDEC GENERAL PERMIT FOR STORMWATER DISCHARGES FROM CONSTRUCTION ACTIVITIES.
- ANY MODIFICATIONS OR DEVIATIONS FROM THE SWPPP, INCLUDING EROSION CONTROL MEASURES AND STORMWATER MANAGEMENT AREAS, SHALL BE DOCUMENTED BY THE OWNER WITH THE ENGINEER AND THE TOWN OF CANANDAIGUA.
- THE OWNER SHALL BE RESPONSIBLE FOR PROVIDING ON-SITE INSPECTIONS BY A LICENSED / CERTIFIED PROFESSIONAL OF CONSTRUCTION EROSION CONTROL DURING CONSTRUCTION. INSPECTIONS ARE TO BE PROVIDED AT A MINIMUM OF ONCE A WEEK AND WITHIN 24 HOURS OF A STORM EVENT THAT GENERATES 0.5 INCHES OF RAINFALL IN A 24 HOUR PERIOD. AN INSPECTION REPORT LOG IS TO BE KEPT ON-SITE BY THE OWNER.
- TEMPORARY SEEDING OF DISTURBED AREAS SHALL BE PROVIDED AS FOLLOWS:
 - THE SURFACE TWO INCHES OF SOIL SHOULD BE LOOSENEED BY DISKING, RAKING, OR BACK-BLADING WITH A BULLDOZER. IMMEDIATELY FERTILIZE WITH 300 LBS. PER ACRE (OR 7 LBS. PER 1000 SQ. FT.) OF 10-10-10 FERTILIZER. IMMEDIATELY SEED WITH THE FOLLOWING MIX:

	LBS./ACRE	LBS./1000 SQ. FT.
ANNUAL RYEGRASS	40	1
PERENNIAL RYEGRASS	40	1
OATS	40	1
WHITE CLOVER (+ INNOCULANT)	4	0.1

SEED SHOULD HAVE A GERMINATION RATE OF AT LEAST 85 PERCENT AND MINIMAL INERT MATERIAL.
- SLOPES 3:1 OR GREATER SHALL BE SEEDDED WITH HEAVY MULCH AND MAY REQUIRE ADDITIONAL STABILIZATION MEASURES. SLOPES SHALL BE FINE GRADED WITH A MINIMUM OF 6" OF TOPSOIL AND SEEDDED WITH THE FOLLOWING SEED MIX:

	LBS./ACRE	% BY PURITY	% GERM
PENNGIFT CROWNVERTCH	40	98	65
BIRDSFOOT TREFOIL	15	98	90
TALL FESCUE	20	90	85

SEEDING RATE: 75 LBS PER ACRE
LIME: RATE OF 1,000 LBS PER ACRE AS NECESSARY TO REACH PH OF 6.0 MIN.
INNOCULANT: RATE AS RECOMMENDED BY THE MANUFACTURER (FOR HYDROSEEDING USE FOUR TIMES MANUFACTURER'S RECOMMENDED RATE)
MULCH: STRAW OR WOOD FIBER MULCH USED WITH A HYDROSEEDING METHOD, AT TWO TONS PER ACRE WITH TACKIFIER.

	LBS./ACRE	% BY PURITY	% GERM
PENNGIFT CROWNVERTCH	40	98	65
BIRDSFOOT TREFOIL	15	98	90
TALL FESCUE	20	90	85

SEEDING RATE: 75 LBS PER ACRE
LIME: RATE OF 1,000 LBS PER ACRE AS NECESSARY TO REACH PH OF 6.0 MIN.
INNOCULANT: RATE AS RECOMMENDED BY THE MANUFACTURER (FOR HYDROSEEDING USE FOUR TIMES MANUFACTURER'S RECOMMENDED RATE)
MULCH: STRAW OR WOOD FIBER MULCH USED WITH A HYDROSEEDING METHOD, AT TWO TONS PER ACRE WITH TACKIFIER.

7) ALL SEEDDED AREAS ARE TO BE MONITORED FOR GERMINATION AND EROSION. ERODED AREAS ARE TO BE BACKFILLED, FINE GRADED AND RE-SEEDDED. AREAS THAT FAIL TO GERMINATE A MINIMUM OF 75% SHALL BE RE-SEEDDED.

8) ALL DISTURBED AREAS TO BE RECLAIMED WITH A MINIMUM OF 6" TOPSOIL.

9) IF THE SOIL DISTURBANCE IS COMPLETELY SUSPENDED AND THE SITE IS PROPERLY STABILIZED, THE OWNER/OPERATOR MAY REDUCE THE SELF-INSPECTION FREQUENCY, BUT SHALL MAINTAIN A MINIMUM OF MONTHLY INSPECTIONS IN ALL SITUATIONS (EVEN WHEN THERE IS A TOTAL WINTER SHUTDOWN). DURING PERIODS OF REDUCED INSPECTION FREQUENCY, INSPECTIONS MUST STILL BE DONE AFTER EVERY STORM EVENT OF 0.5 INCHES OR GREATER.

10) THE OWNER'S CONTRACTOR SHALL BE RESPONSIBLE FOR THE ESTABLISHMENT, MAINTENANCE, CLEANING, REPAIR AND REPLACEMENT OF EROSION CONTROL MEASURES DURING SITE CONSTRUCTION.

11) THE OWNER IS RESPONSIBLE FOR FILING A NOTICE OF INTENT (NOI) FOR CONSTRUCTION ACTIVITY WITH NYSDEC PRIOR TO COMMENCING ANY CONSTRUCTION. A COPY OF THE N.O.I. SHALL BE KEPT ON-SITE AND PROVIDED TO THE MUNICIPALITY. UPON COMPLETION OF CONSTRUCTION, (WHEN THE ENTIRE SITE IS STABILIZED AND 80% COVER IS EVIDENT) THE OWNER MAY FILE A NOTICE OF TERMINATION (NOT) WITH NYSDEC.

LEGEND

	PARCEL BOUNDARY		UTILITY POLE
	ADJACENT PARCEL BOUNDARY		LIGHT POLE
	RIGHT-OF-WAY-LINE		HYDRANT
	EXISTING PAVEMENT, CURB		WATER VALVE
	EXISTING BUILDING		WATER MANHOLE
	CENTER LINE		SOIL BORING
	SETBACK LINE		MAIL BOX
	PROPOSED EASEMENT LINE		TELEPHONE MANHOLE
	EXISTING WATERMAIN, VALVE, AND HYDRANT		TELEPHONE PEDESTAL
	PROPOSED WATERMAIN, VALVE, AND HYDRANT		TRANSFORMER
	EX. STORM SEWER WITH MANHOLE		BITUMINOUS ASPHALT
	CATCH BASIN, END SECTION		POST
	MANHOLE		SIGN
	INLET MANHOLE		IRON PIPE FOUND
	EX. SANITARY SEWER WITH MANHOLE		STONE MONUMENT FOUND
	PROPOSED SANITARY SEWER LATERAL		CAPPED IRON ROD FOUND
	EXISTING POWER POLE W/O.H. WIRES		IRON ROD FOUND
	EXISTING UNDERGROUND ELECTRIC		CAPPED IRON ROD SET
	EXISTING GAS MAIN AND VALVE		CATCH BASIN
	PROPOSED GAS MAIN AND VALVE		DRAIN MANHOLE
	UNDERGROUND TELEPHONE		SANITARY MANHOLE
	EXISTING CONCRETE WALK		CLEANOUT
	EXISTING BLACKTOP DRIVEWAY		GAS VALVE
	EXISTING BLACKTOP WALK		ELECTRIC MANHOLE
	EXISTING CONCRETE RETAINING WALL		
	EXISTING CONTOUR		
	PROPOSED CONTOUR		
	EXISTING SPOT ELEVATION		
	PROPOSED SPOT ELEVATION		
	TREE/VEGETATION PROTECTION BARRIER		
	BOTTOM OF CURB		
	TOP OF WALL		
	TOP OF CURB		
	BOTTOM OF STEP		
	TOP OF STEP		

MLA

Phone (585) 218-0300
Fax (585) 218-0372

McCord

Landscape Architecture, PLLC

2129 Five Mile Line Road
Penfield, New York 14526

COPYRIGHT © 2015
McCORD SNYDER LANDSCAPE
ARCHITECTURE, PLLC

DRAWING ALTERATION
IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS
ACTING UNDER THE DIRECTION OF LICENSED ARCHITECT,
PROFESSIONAL ENGINEER, LANDSCAPE ARCHITECT, OR LAND
SURVEYER TO ALTER ANY ITEM ON THIS DOCUMENT IN
ANY WAY.

ANY LICENSEE WHO ALTERS THIS DOCUMENT IS REQUIRED
BY LAW TO AFFIX HIS OR HER SEAL AND THE NOTATION
"ALTERED BY" FOLLOWED BY HIS OR HER SIGNATURE AND
SPECIFIC DESCRIPTION OF THE ALTERATION.

PROJECT

Y

188

Y .332,

Y , Y

TITLE OF DRAWING

DATE

9/18/15

DRAWN BY


LAG

CHECKED BY

DCM

SCALE

AS SHOWN

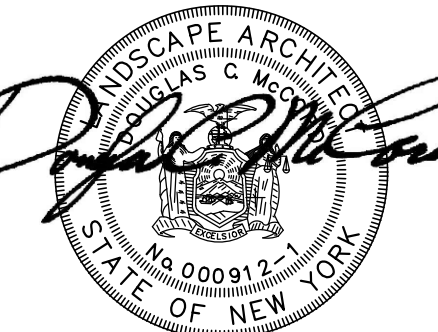

Professional seal of the State of New York, Landscape Architecture, PLLC, dated 09/09/15.

8			
7			
6			
5			
4	REVS PER TOWN ENGINEER	2/3 2016	LAG
3	GENERAL REVISIONS	1/8 2016	LAG
2	GENERAL REVISIONS	11/30 2015	LAG
1	GENERAL REVISIONS	10/22 2015	LAG
	REVISIONS	DATE	BY

PROJECT NO.

870

DRAWING NO.

N-1